

ADDENDUM NO. 3

To the Plans, Specifications & General Contract Documents

Public Paving, Drainage, Water, Sanitary Sewer, Street
Light & Traffic Signal
Improvements

To Serve

Intermodal Parkway BNSF to Old FM 156

CITY PROJECT NO.: 103332

Bid Date: January 25th, 2024 @ 1:30 PM
Addendum No. 3 Issued January 16th, 2024

The Contract Documents, Specifications, and Plans for the subject project are hereby amended as follows:

SPECIFICATIONS & CONTRACT DOCUMENTS:

1. Document Modified: 00 11 16 Invitation to Proposers

Description of Change: Bid date has been moved to January 25th, 2024.

2. Document Modified: Plan Sheet C509, C510, and C511.

Description of Change: Addendum No. 2 identified the expansion joint details. Since that Addendum No. 2, the Geotechnical Engineer has notified the design team a re-design for the expansion joint dowels as such: #12 bars @ 12" O.C.E.W and 18" in length.

Also, the rebar within the standard concrete pavement detail has been updated to reflect #4 bars @ 18" O.C.E.W.

- 3.. General: Can potential bidders for the Intermodal Parkway project bid dual walled corrugated polypropylene pipe (HP Storm) in lieu of RCP?

Description of Change: HP Storm pipe can be provided as an alternate bid item. It needs to be provided as an alternate bid item(s) along with the RCP as the base bid.

This Addendum, forms part of the Contract Documents referenced above and modifies the original Contract Documents and Plans. Bidder shall acknowledge receipt of this addendum in the space provided below, on the last page of the Bid Form and acknowledge receipt on the outer envelope of your bid.

A signed copy of this Addendum should be included in the sealed bid envelope at the time of bid submittal. Failure to acknowledge the receipt of this Addendum could cause the subject bidder to be considered "NONRESPONSIVE," resulting in disqualification.

RECIPT ACKNOWLEDGEMENT:

ISSUED BY:

Peloton Land Solutions a Westwood Company

By: _____

By:  _____

Kole Weber

Company: _____

Director, Commercial

Address: _____

ACCEPTED BY CITY:

City: _____ State: _____

 _____

Bradley Radovich

Project Manage

SECTION 00 11 16
INVITATION TO PROPOSERS

RECEIPT OF PROPOSALS

Sealed proposals for the construction of *Paving, Drainage, Water, Sewer, Street Lights & Traffic Signals – Intermodal Parkway* will be received by the City of Fort Worth Purchasing Office until January 25, 2024 @1:30 pm:

City of Fort Worth
Purchasing Division
200 Texas Street
Fort Worth, Texas 76102

Proposals will be accepted by: US Mail, Courier, FedEx or hand delivery at the address above;

Proposals will be opened publicly and read aloud at 2:00 PM CST in the City Council Chambers.

GENERAL DESCRIPTION OF WORK

The major work will consist of the (approximate) following:

Paving Improvements (Approximately 20,000 SY of 16.5” Concrete Pavement)
Storm Drain improvements (Drains ranging from 21” RCP to 8’x4’ Concrete Boxes)
Traffic Signal Installation
Removal of Existing Roadway

PREQUALIFICATION

Certain improvements included in this project must be performed by a contractor or designated subcontractor who is pre-qualified by the City at the time of bid opening. The procedures for qualification and pre-qualification are outlined in the Section 3 of 00 21 13 – INSTRUCTIONS TO PROPOSERS.

DOCUMENT EXAMINATION AND PROCUREMENTS

The Request for Proposal (RFP) and Contract Documents may be examined or obtained on-line by visiting the City of Fort Worth’s Purchasing Division website at <http://www.fortworthtexas.gov/purchasing/> and clicking on the link to the advertised project folders on the City’s electronic document management and collaboration system site. The Contract Documents may be downloaded, viewed, and printed by interested contractors and/or suppliers.

EXPRESSION OF INTEREST

To ensure potential proposers are kept up to date of any new information pertinent to this project, all interested parties are requested to email Expressions of Interest in this procurement to the City Project Manager and the Design Engineer. The email should include the company’s name, contact person and that individual’s email address and phone number. All Addenda will be distributed directly to those who have expressed an interest in the procurement and will also be posted in the City of Fort Worth’s purchasing website at <http://fortworthtexas.gov/purchasing/>

PRE-PROPOSAL CONFERENCE

A Pre-proposal conference will be held as described in Section 00 21 16 - INSTRUCTIONS TO PROPOSERS at the following date, and time via a web conferencing application:

DATE: January 9th, 2024

TIME: 10:00 am CST

LOCATION: Room 2154, City Hall, 200 Texas Street, Fort Worth 76102

ONLINE MEETING, use ID Below:

Microsoft Teams: ID 228 107 224 413

Passcode: gavYWd

CITY'S RIGHT TO ACCEPT OR REJECT PROPOSALS

City reserves the right to waive irregularities and to accept or reject any or all bids.

AWARD

City will award a contract to the proposer presenting the best value, qualifications, competences, price, and schedule considered.

INQUIRIES

All inquiries relative to this procurement should be addressed to the following:

Attn: Bradley Radovich

Email: Bradley.radovich@fortworthtexas.gov

Phone: 817-392-7817


Phone: 682-432-4525

ADVERTISEMENT DATES


December 14th, 2023

December 21st, 2023


END OF SECTION

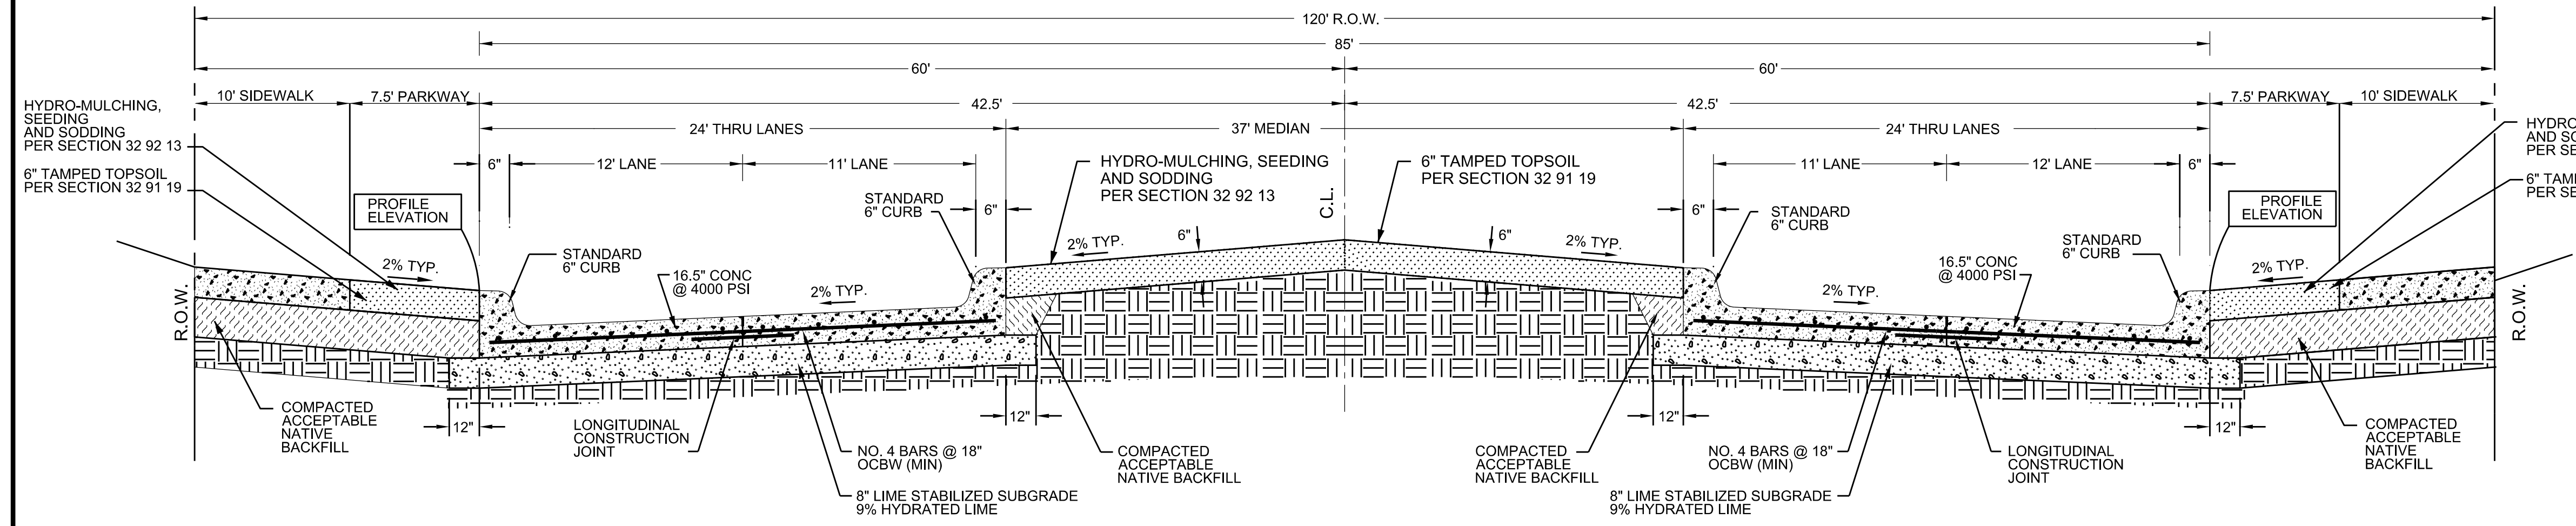

A INTERMODAL PARKWAY
TYPICAL SECTION
NTS

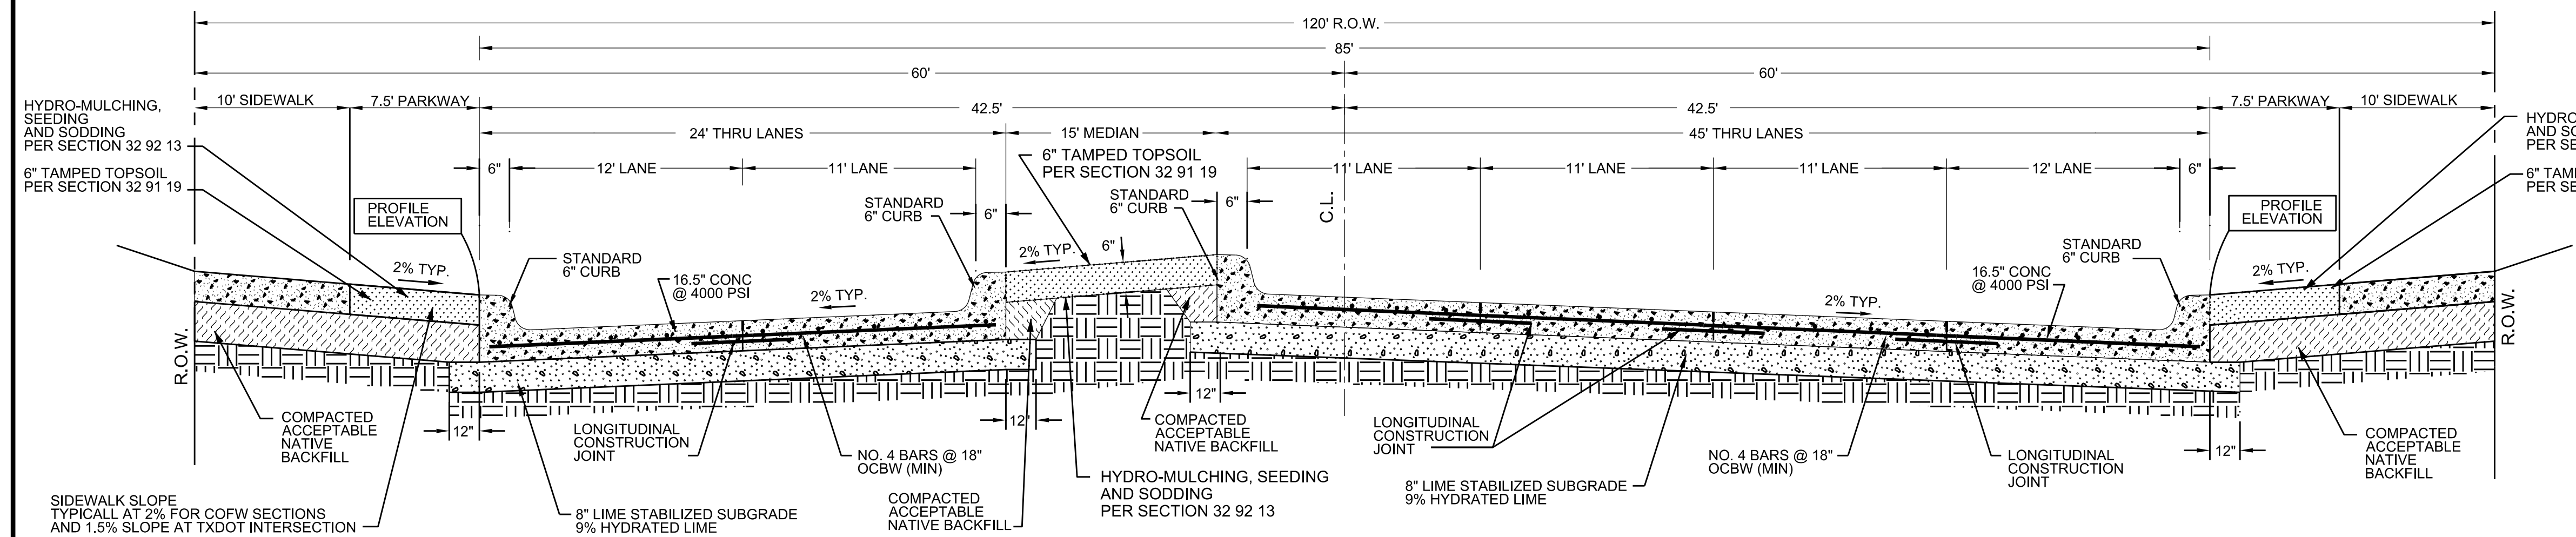


B INTERMODAL PARKWAY
LEFT TURN LANE FM 156
NTS

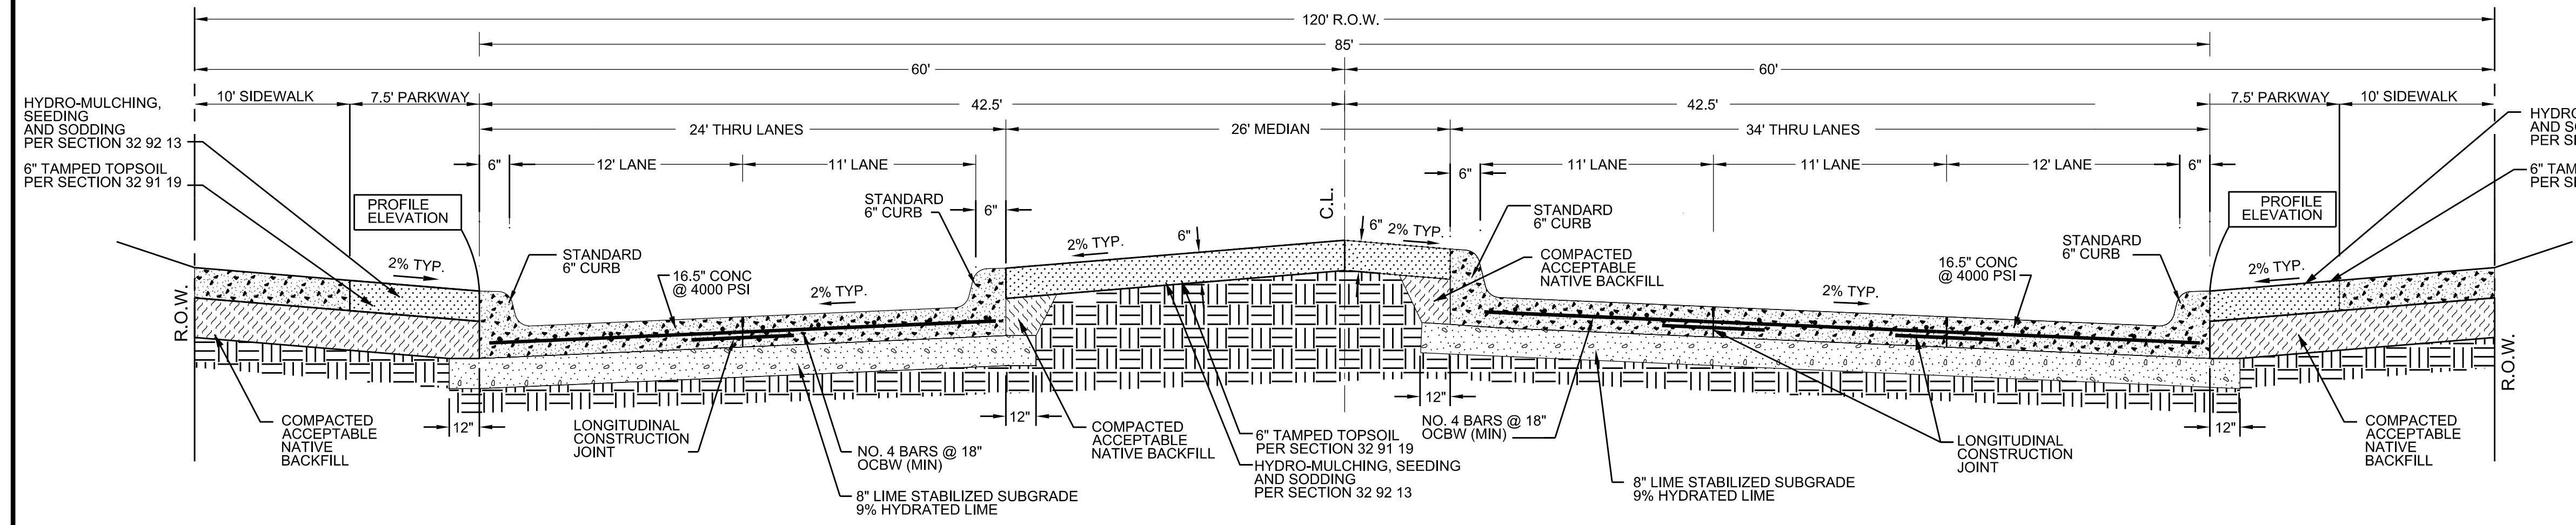


C INTERMODAL PARKWAY
LEFT TURN LANE - WESTBOUND
NTS


- NOTES:
- PAVING RECOMMENDATIONS ARE MADE BY TERRACON CONSULTANTS, INC. IN REPORT NO. 95165202, DATED JANUARY 16, 2017.
 - CONTRACTOR SHALL OBTAIN A COPY OF SAID GEOTECHNICAL ENGINEERING REPORT AND FAMILIARIZE HIMSELF PRIOR TO BIDDING AND CONSTRUCTING THE IMPROVEMENTS OF THE PROJECT.
 - CROSS SECTION LOCATIONS ON GRADING PLANS.

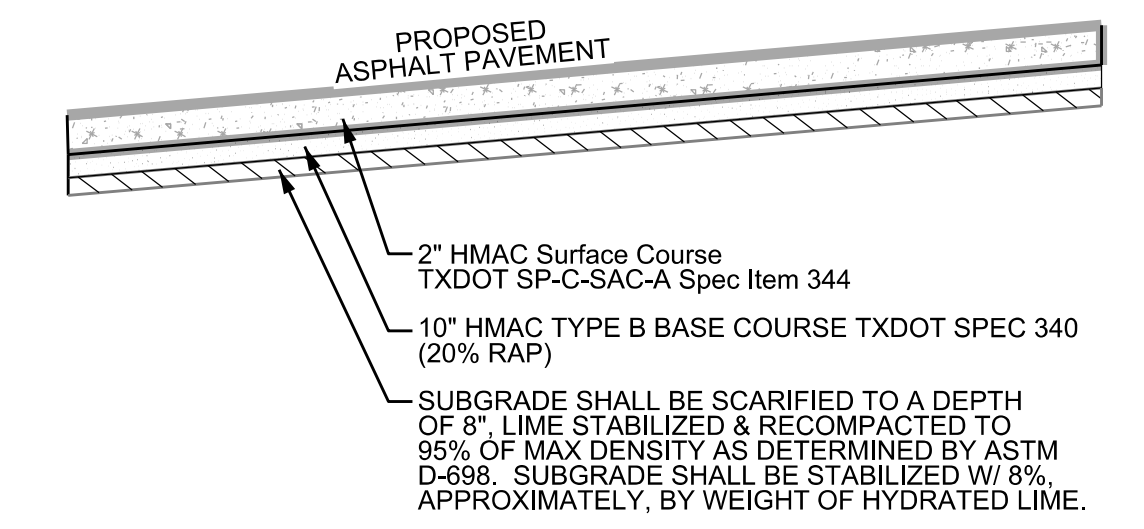

ASPHALT SECTION -TXDOT INTERSECTION
NOT TO SCALE

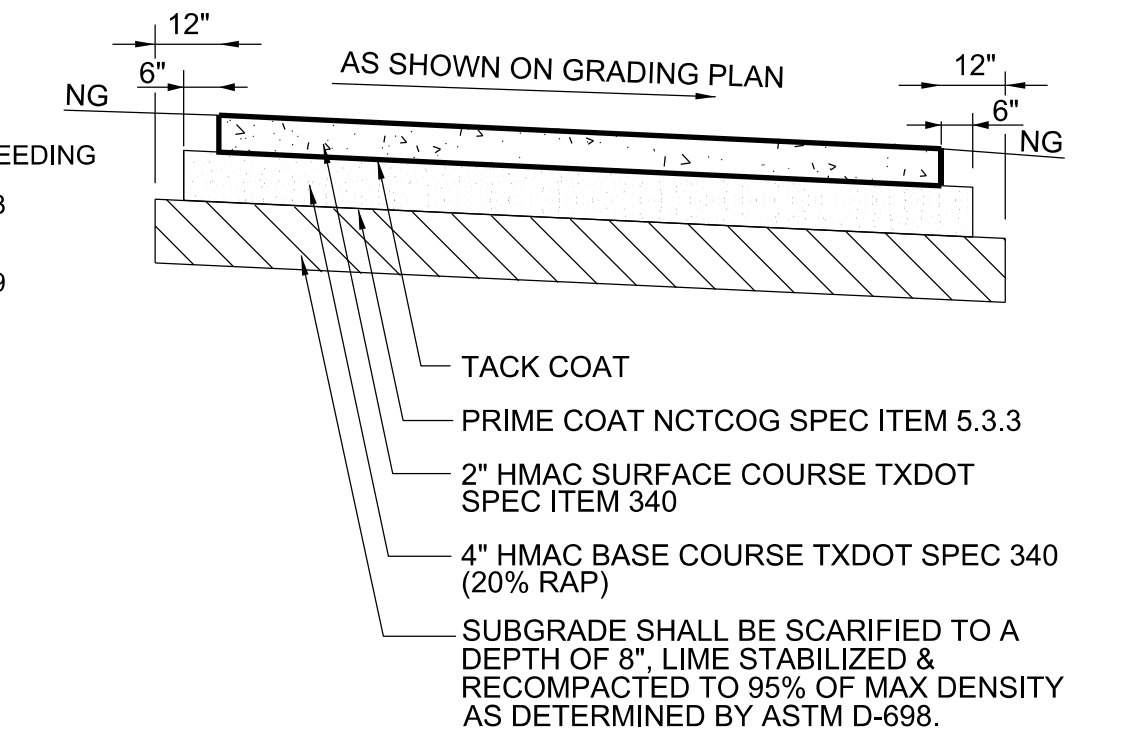

TEMPORARY ASPHALT
PAVEMENT SECTION
NOT TO SCALE

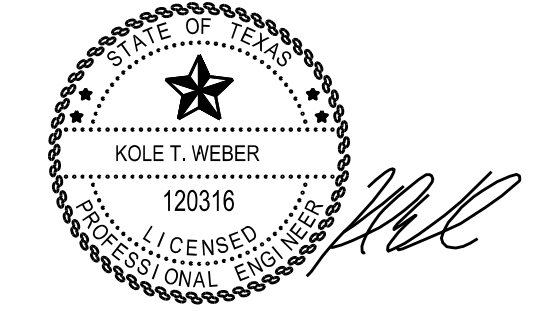

10/10/2022
PELTON LAND SOLUTIONS
TEXAS FIRM NO. 12207
The seal appearing on this document was authorized by Kole T. Weber, P.E. No. 120316. Alteration of a sealed document without proper notification to the responsible engineer is an offense under the Texas Engineering Practice Act

REV.	DATE	REMARKS

INTERMODAL PARKWAY

PAVING SECTIONS


CITY OF FORT WORTH, TEXAS
TRANSPORTATION AND PUBLIC WORKS DEPT.
ENGINEERING DIVISION

PELTON
LAND SOLUTIONS

9800 HILLWOOD PARKWAY
SUITE 250
FORT WORTH, TX 76177
PHONE: 817-562-3350
TX FIRM NO. 12207


DESIGNED: RZ	DATE: OCT 2022	FILE	SHEET
DRAWN: TCG			C509
CHECKED: KTW			

G:\JOB\HWA17030_01_Intermodal\MasterDev\Civil\CAD_Public_Construction_Plans\C509-HWA17030_01-C-PAV-DET1.dwg

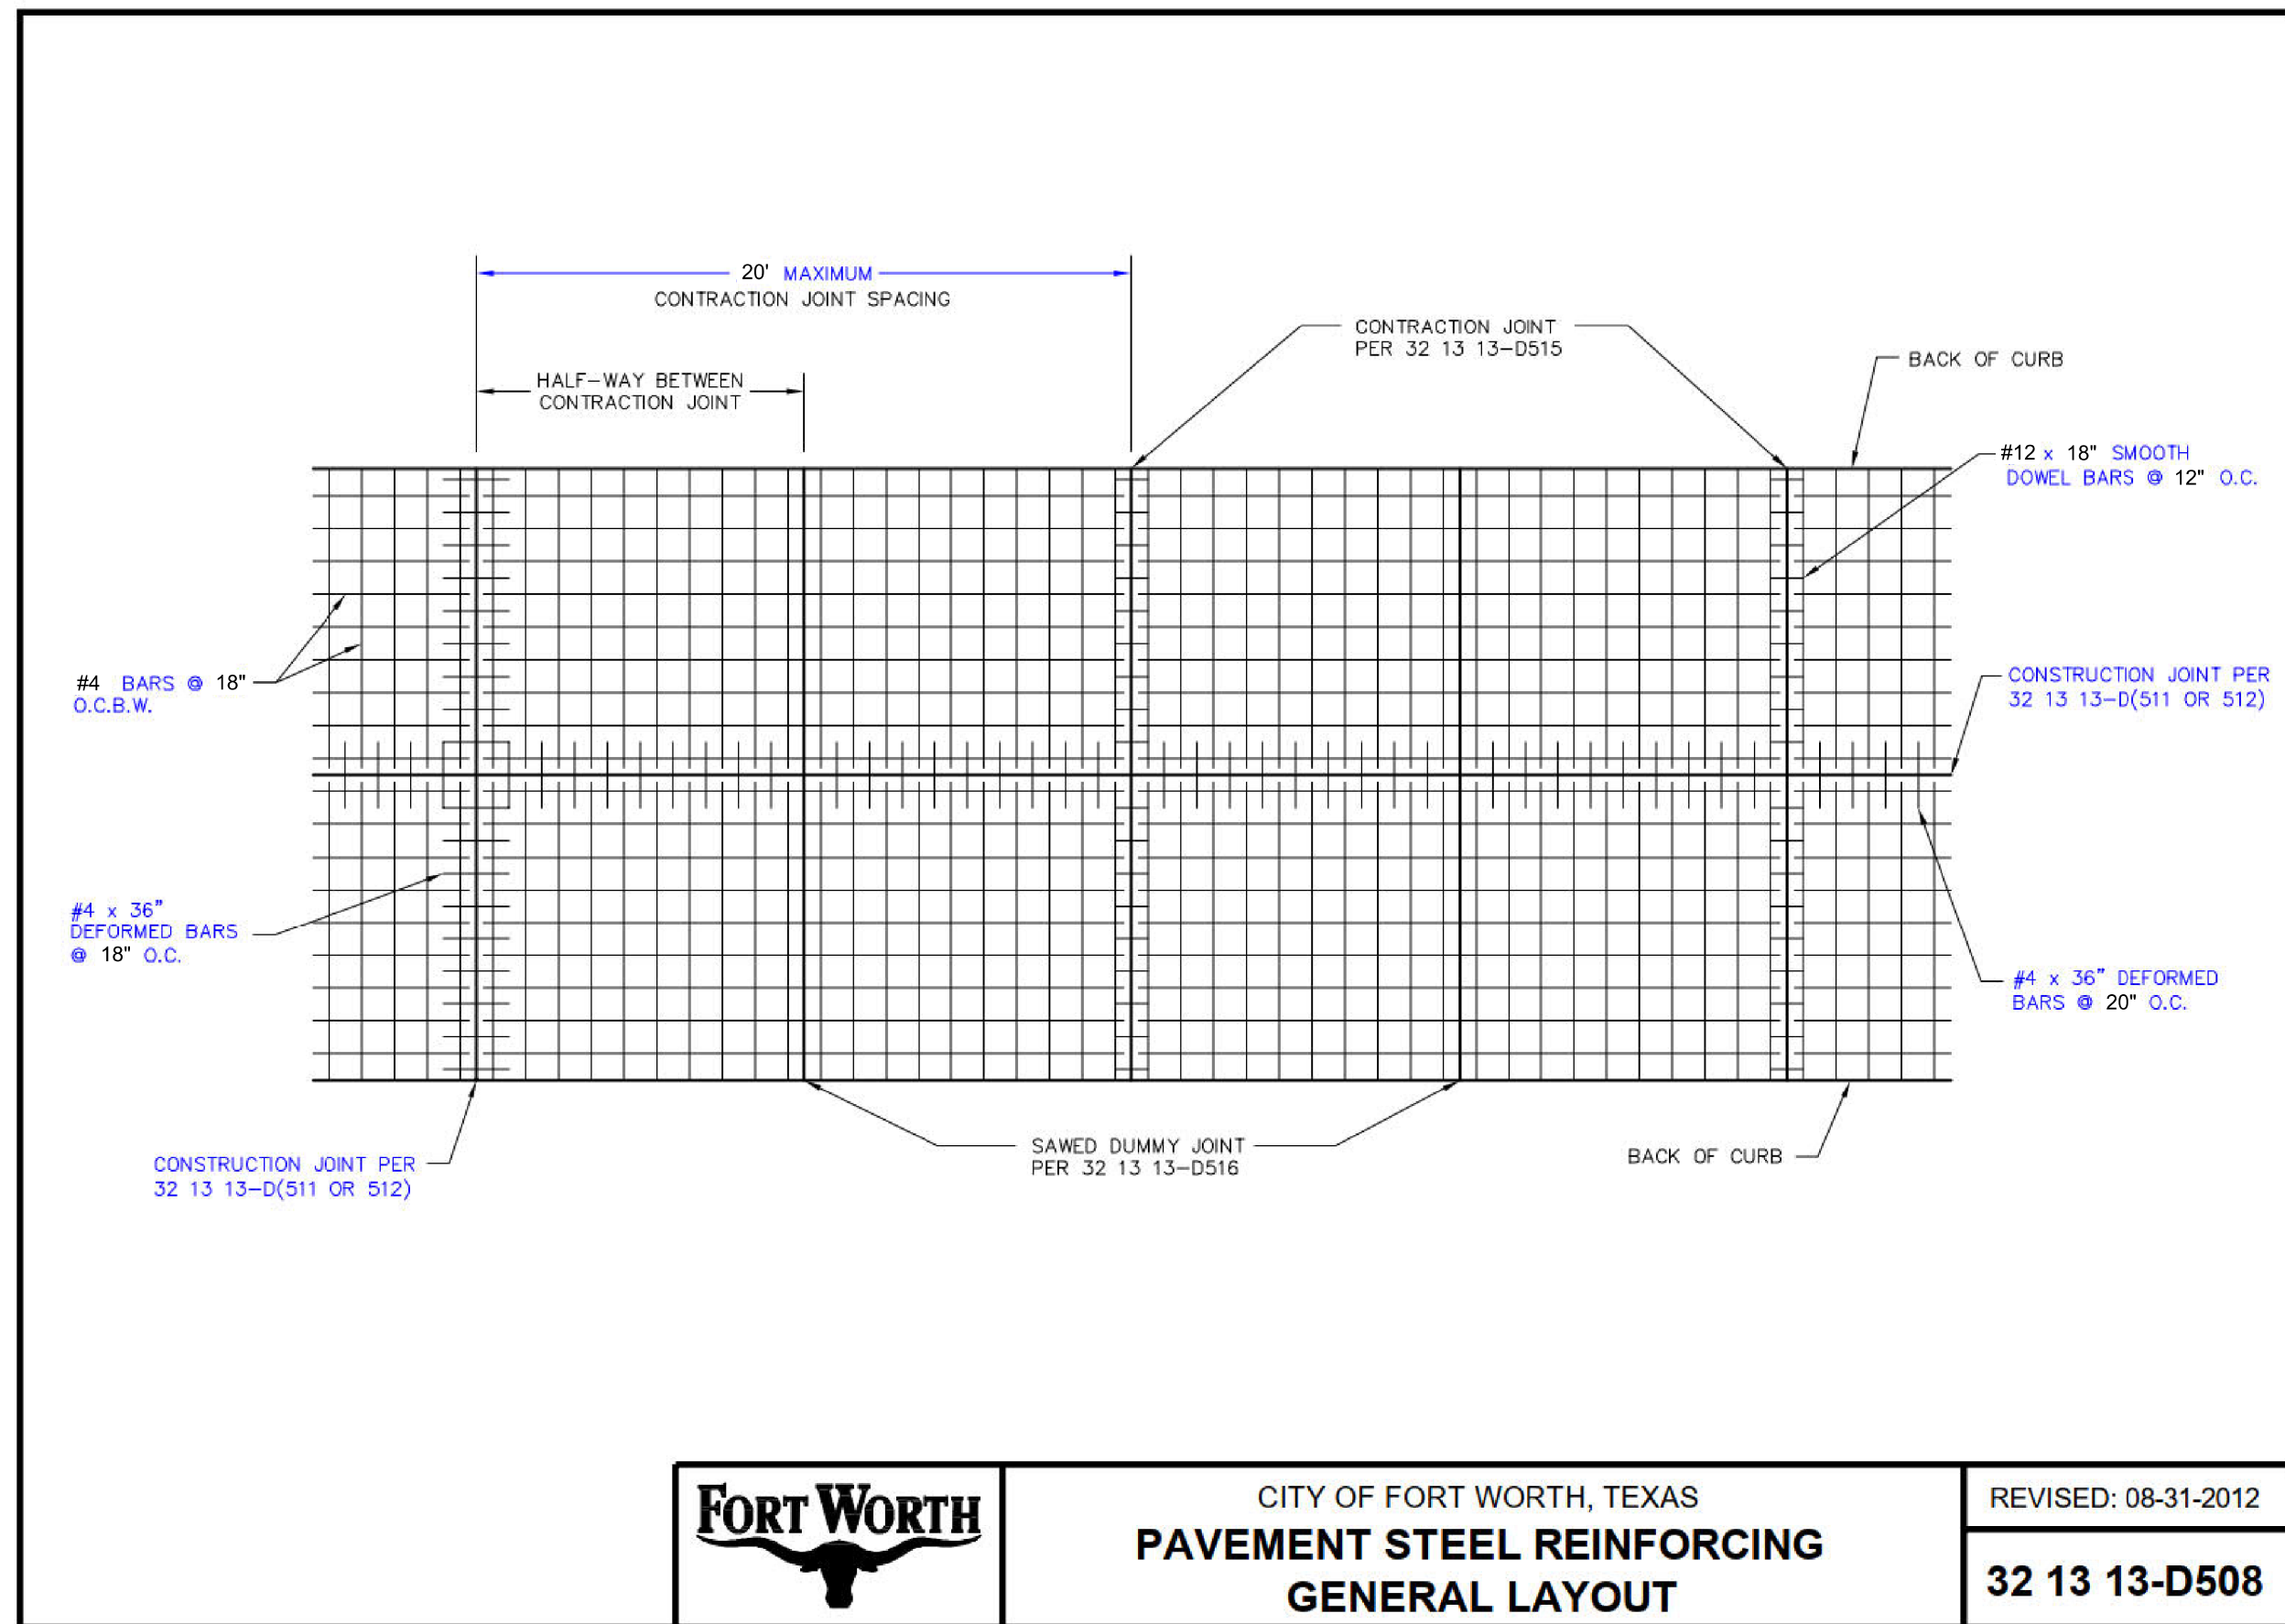


CITY OF FORT WORTH, TEXAS
**PAVEMENT STEEL REINFORCING
 GENERAL LAYOUT**

REVISED: 08-31-2012
32 13 13-D508

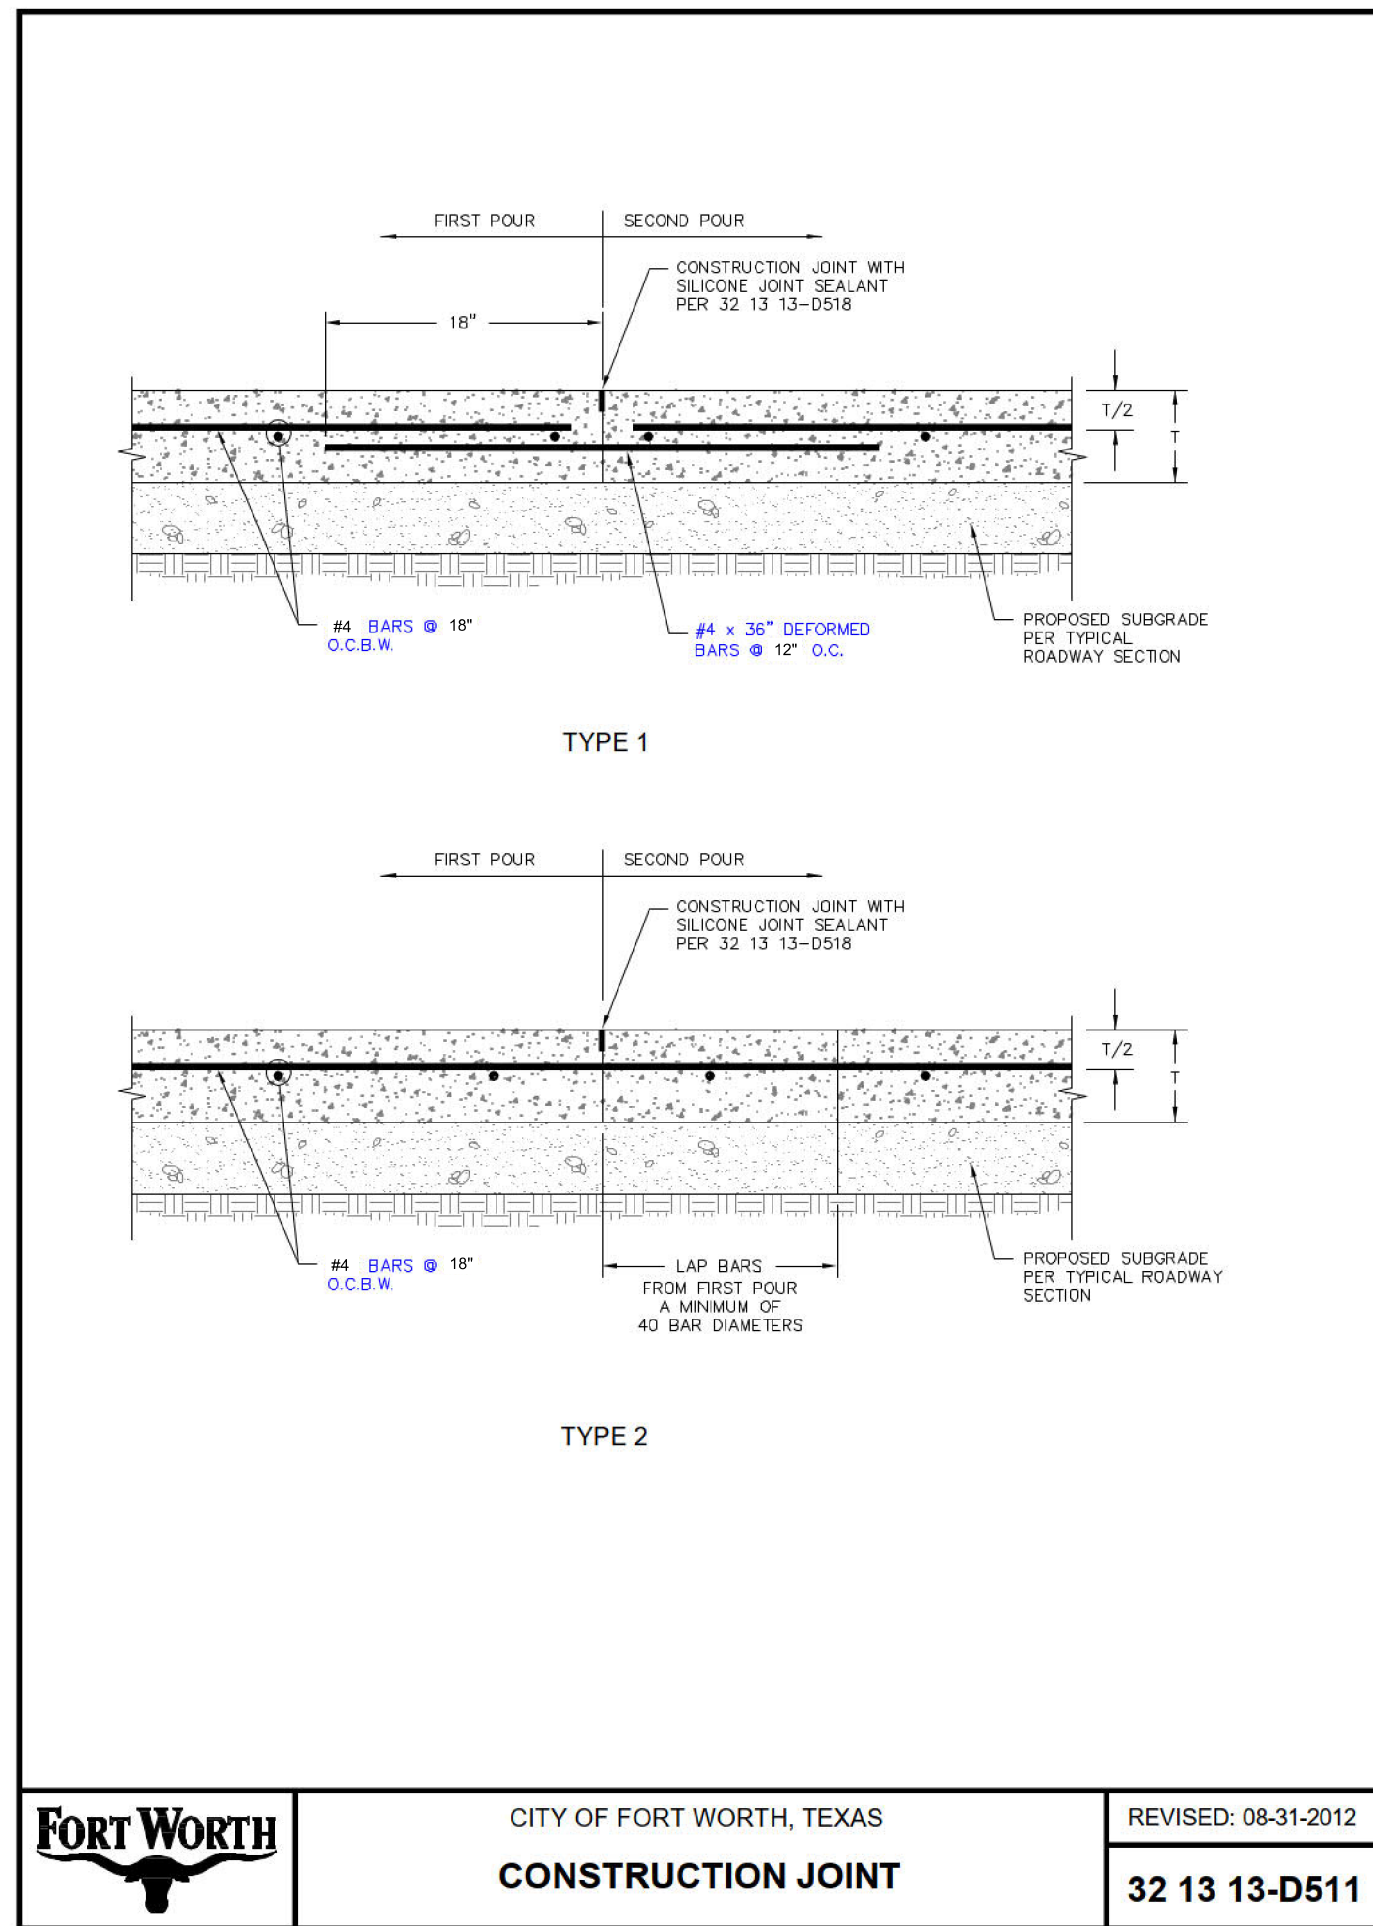


CITY OF FORT WORTH, TEXAS
CONSTRUCTION JOINT

REVISED: 08-31-2012
32 13 13-D511

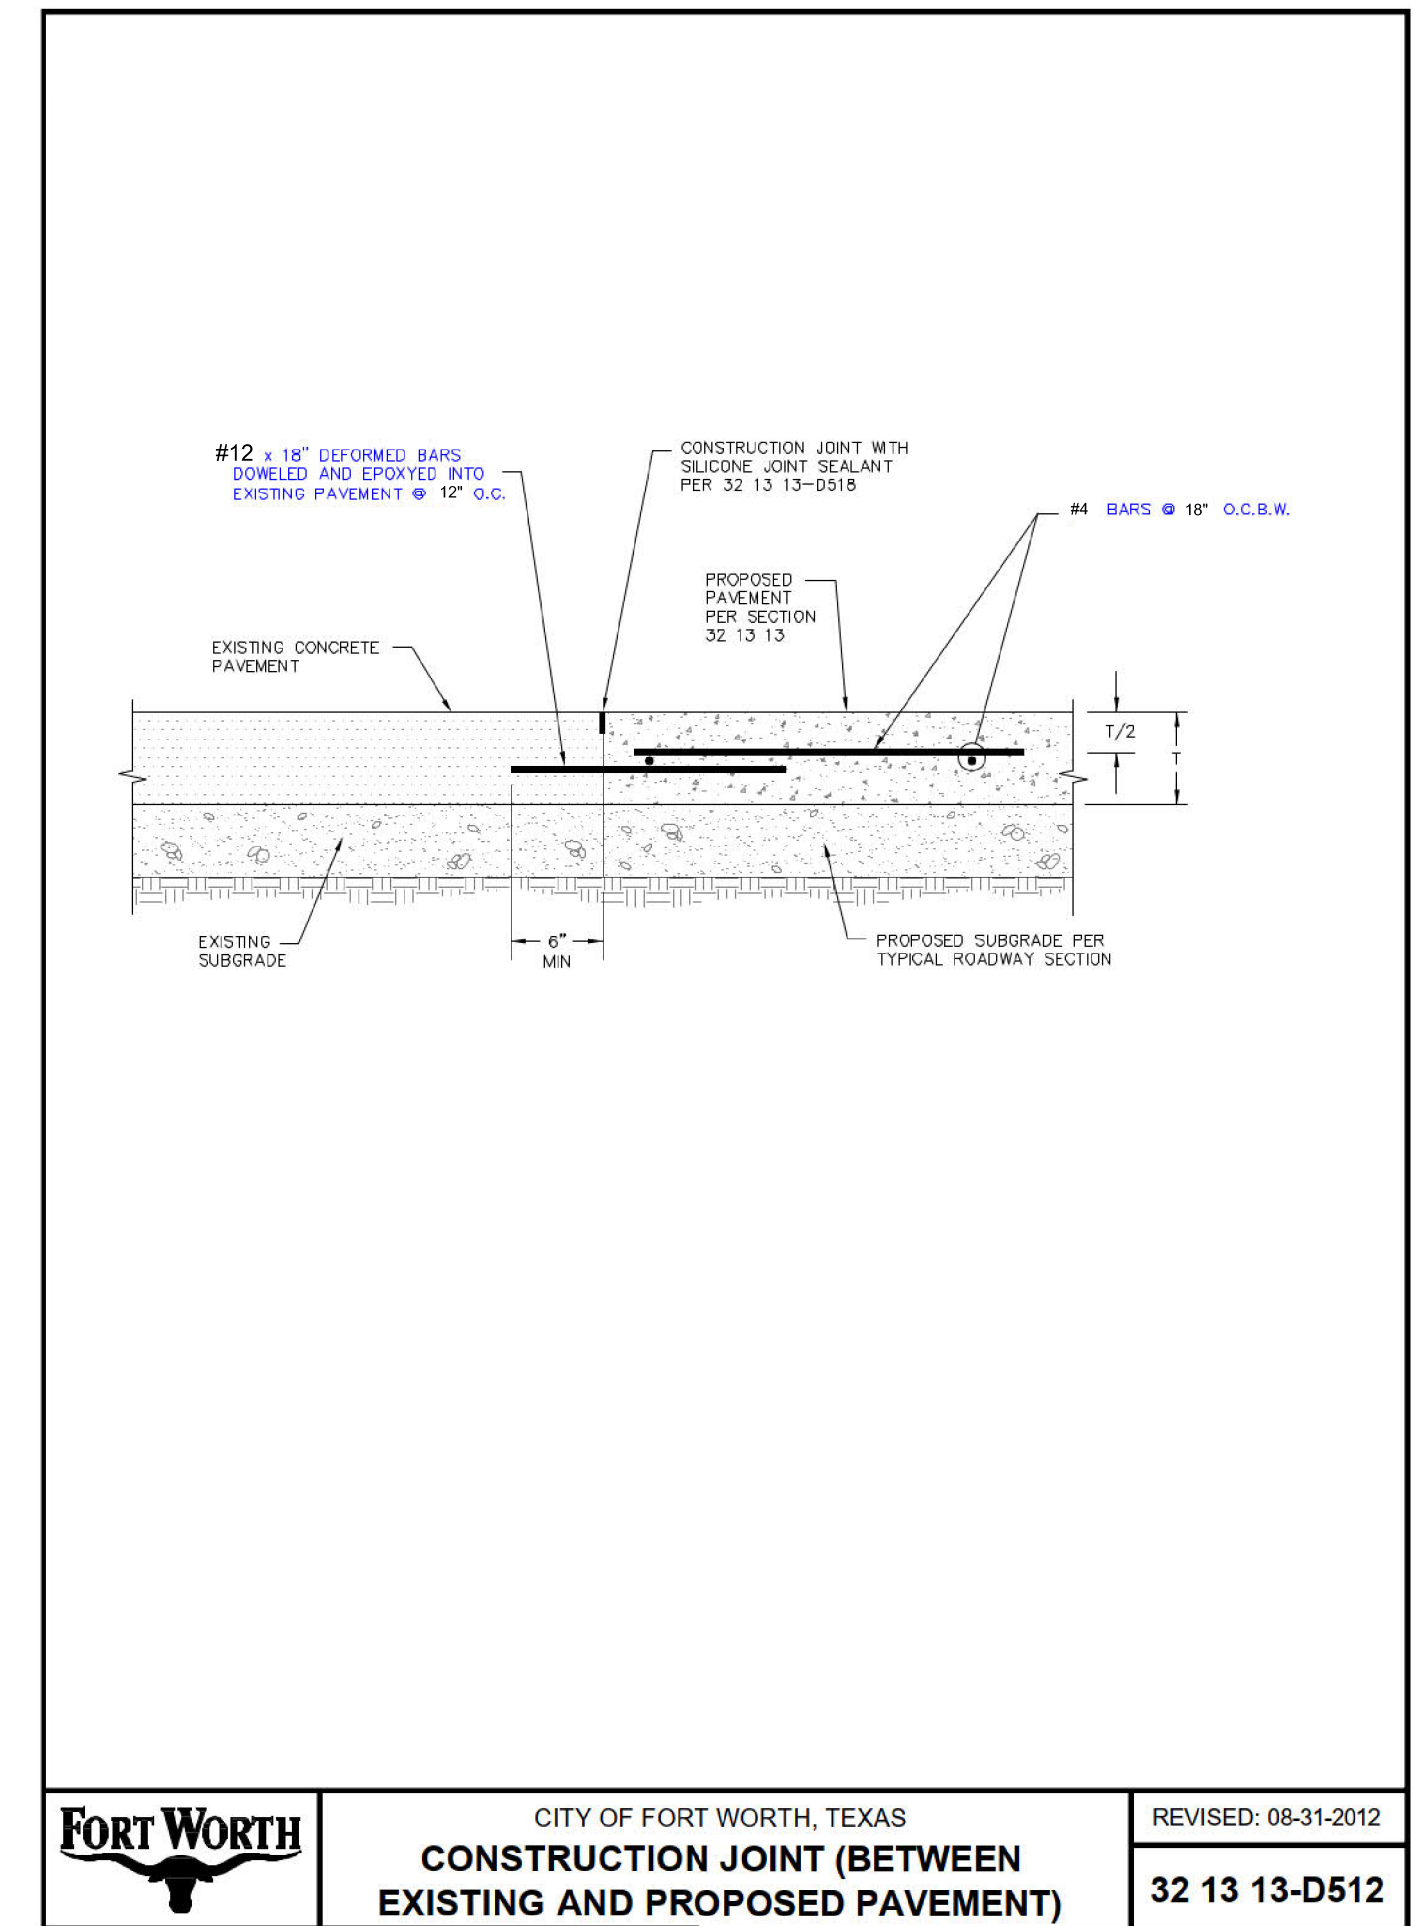


CITY OF FORT WORTH, TEXAS
**CONSTRUCTION JOINT (BETWEEN
 EXISTING AND PROPOSED PAVEMENT)**

REVISED: 08-31-2012
32 13 13-D512

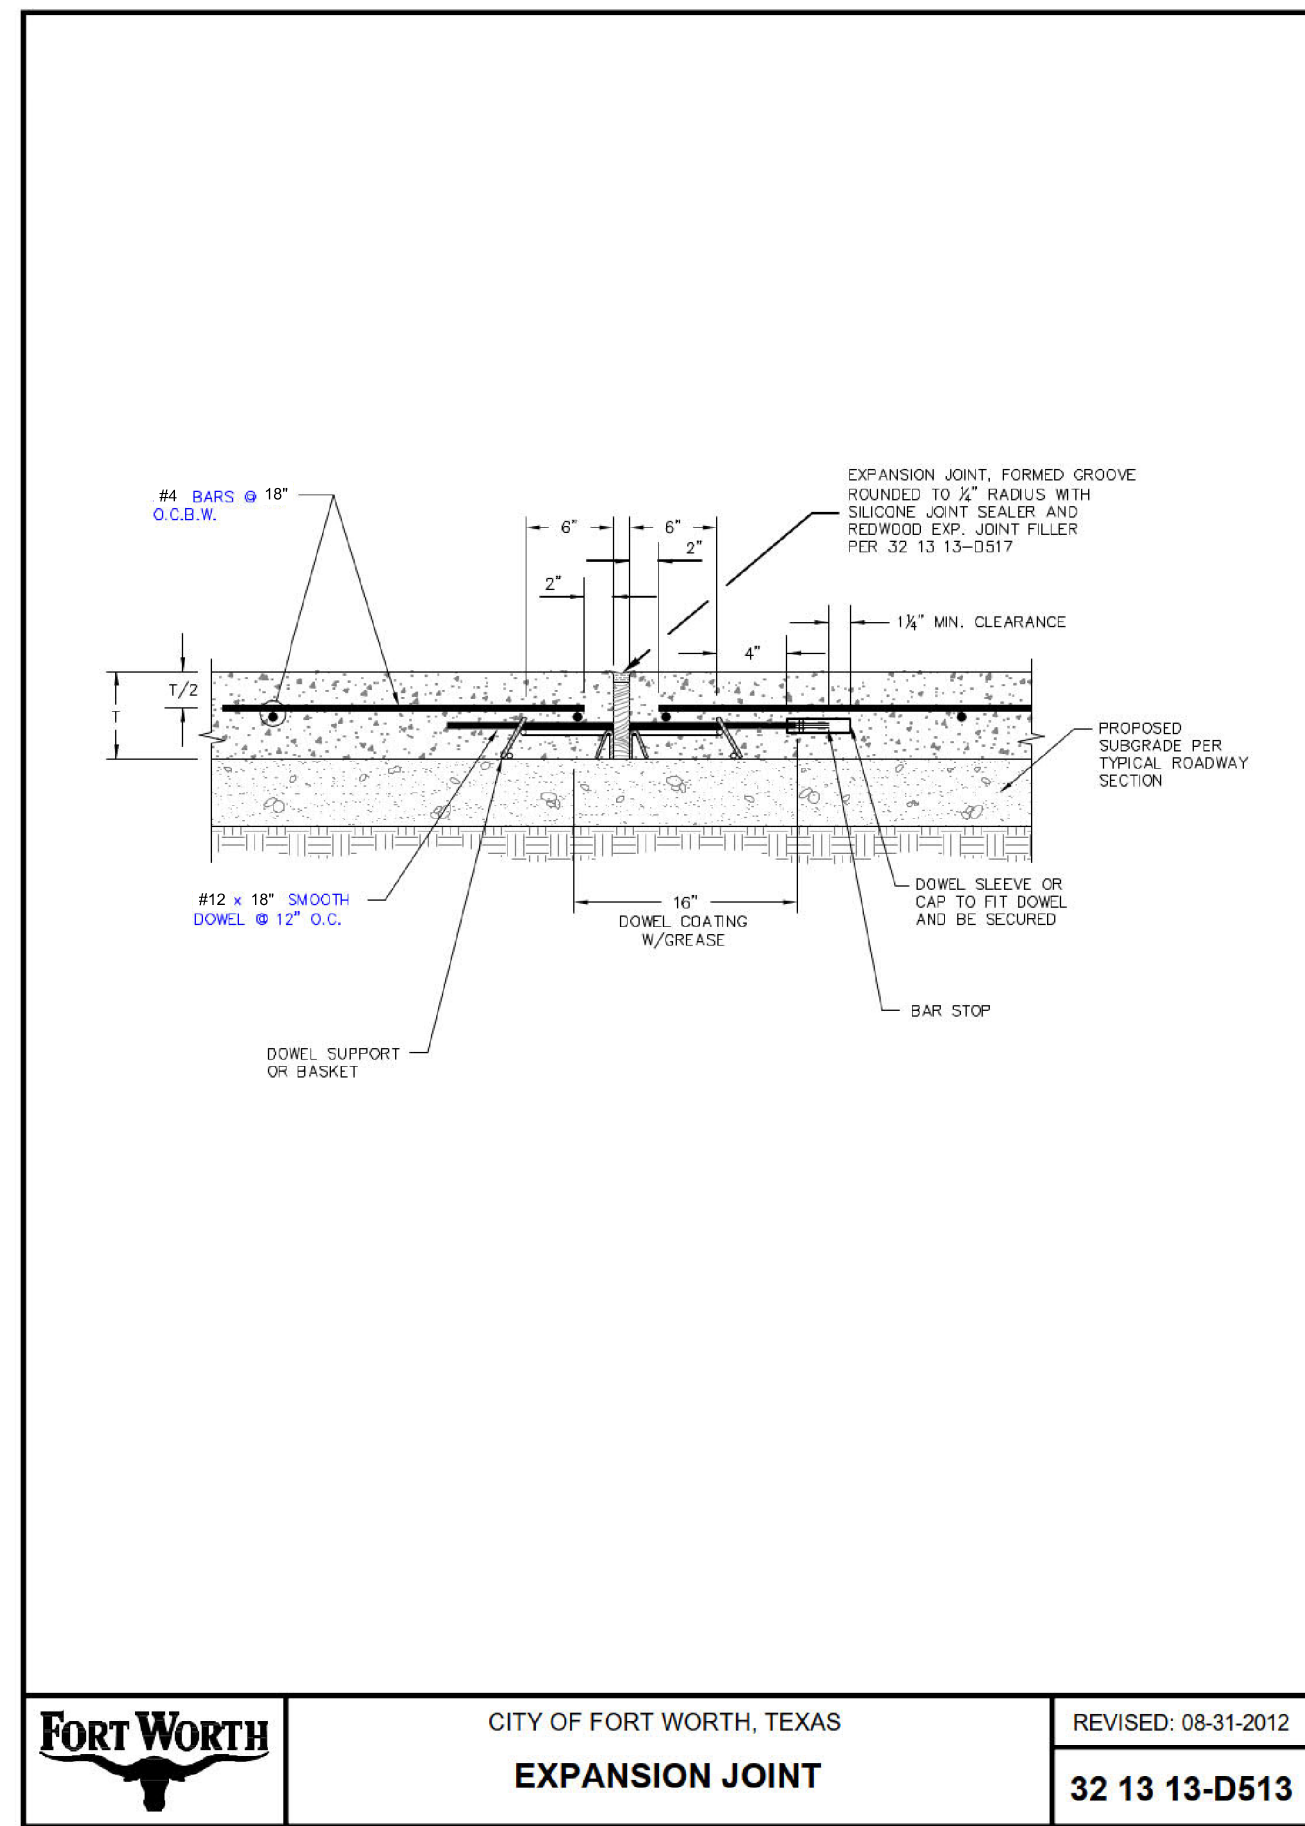


CITY OF FORT WORTH, TEXAS
EXPANSION JOINT

REVISED: 08-31-2012
32 13 13-D513

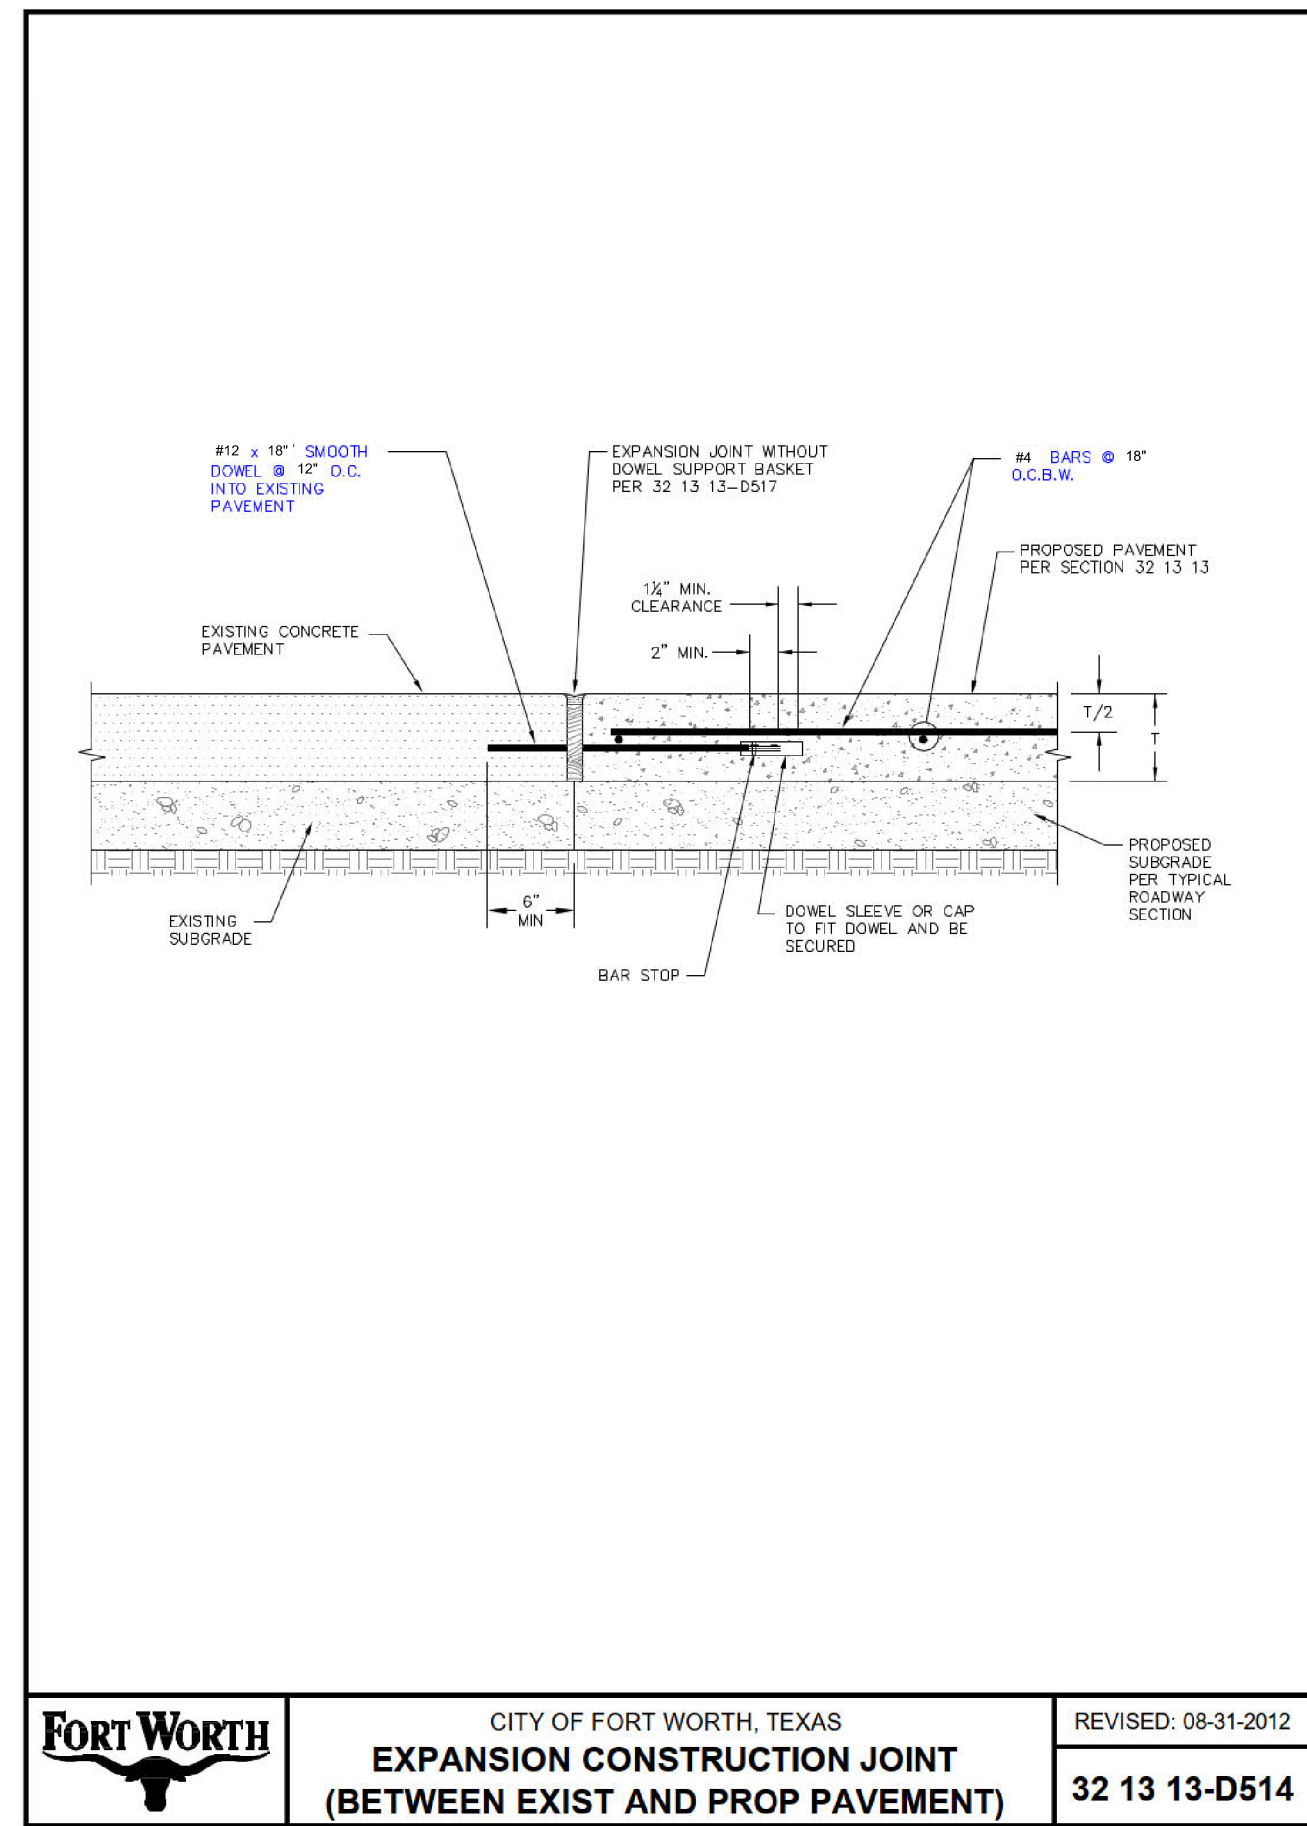

CITY OF FORT WORTH, TEXAS
**EXPANSION CONSTRUCTION JOINT
 (BETWEEN EXIST AND PROP PAVEMENT)**

REVISED: 08-31-2012
32 13 13-D514

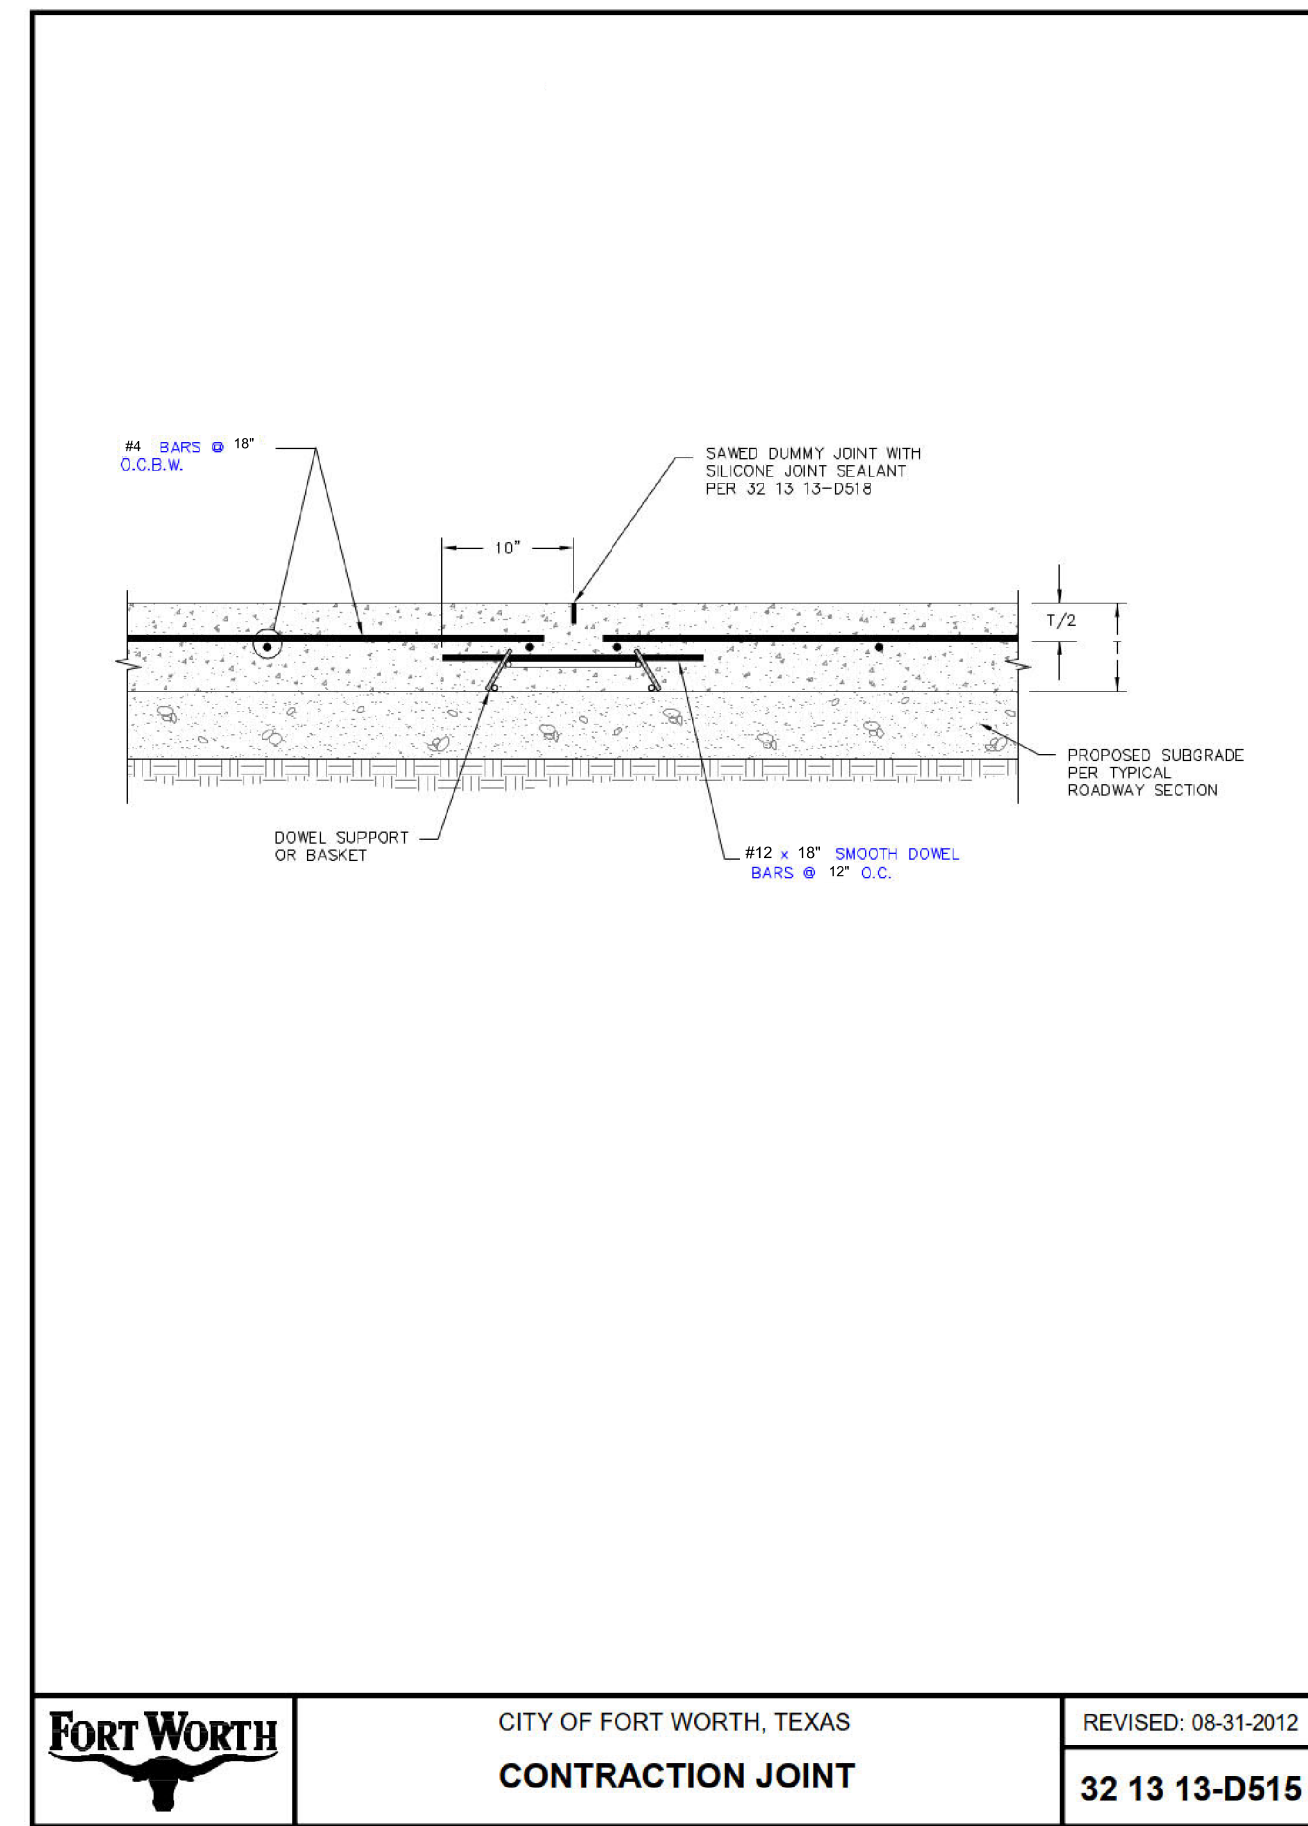

CITY OF FORT WORTH, TEXAS
CONTRACTION JOINT


REVISED: 08-31-2012
32 13 13-D515

NOTES:
 THE CONCRETE SHOULD HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4,000 PSI. IT SHOULD CONTAIN A MINIMUM OF 4.5 ± 1.5 PERCENT ENTRAINED AIR.
 ALL CONTRACTION JOINTS SHOULD HAVE SMOOTH DOWELS SPACE 12 INCHES ON CENTER AT MID-HEIGHT OF SLAB. PER GEOTECHNICAL REPORT # 95165202


REV.	DATE	REMARKS

INTERMODAL PARKWAY			
PAVING DETAIL			
CITY OF FORT WORTH, TEXAS TRANSPORTATION AND PUBLIC WORKS DEPT. ENGINEERING DIVISION			
		9800 HILLWOOD PARKWAY SUITE 250 FORT WORTH, TX 76177 PHONE: 817-562-3350 TX FIRM NO. 12207	
DESIGNED: RZ	DATE: OCT 2022	FILE	SHEET
DRAWN: TCG			C510
CHECKED: KTW			


C:\JOB\HWA17030_01_Intermodal\MasterDev\Civil\CAD_Public_Construction_Plans\C510-HWA17030_01-C-PAV-DET.L2.RVT

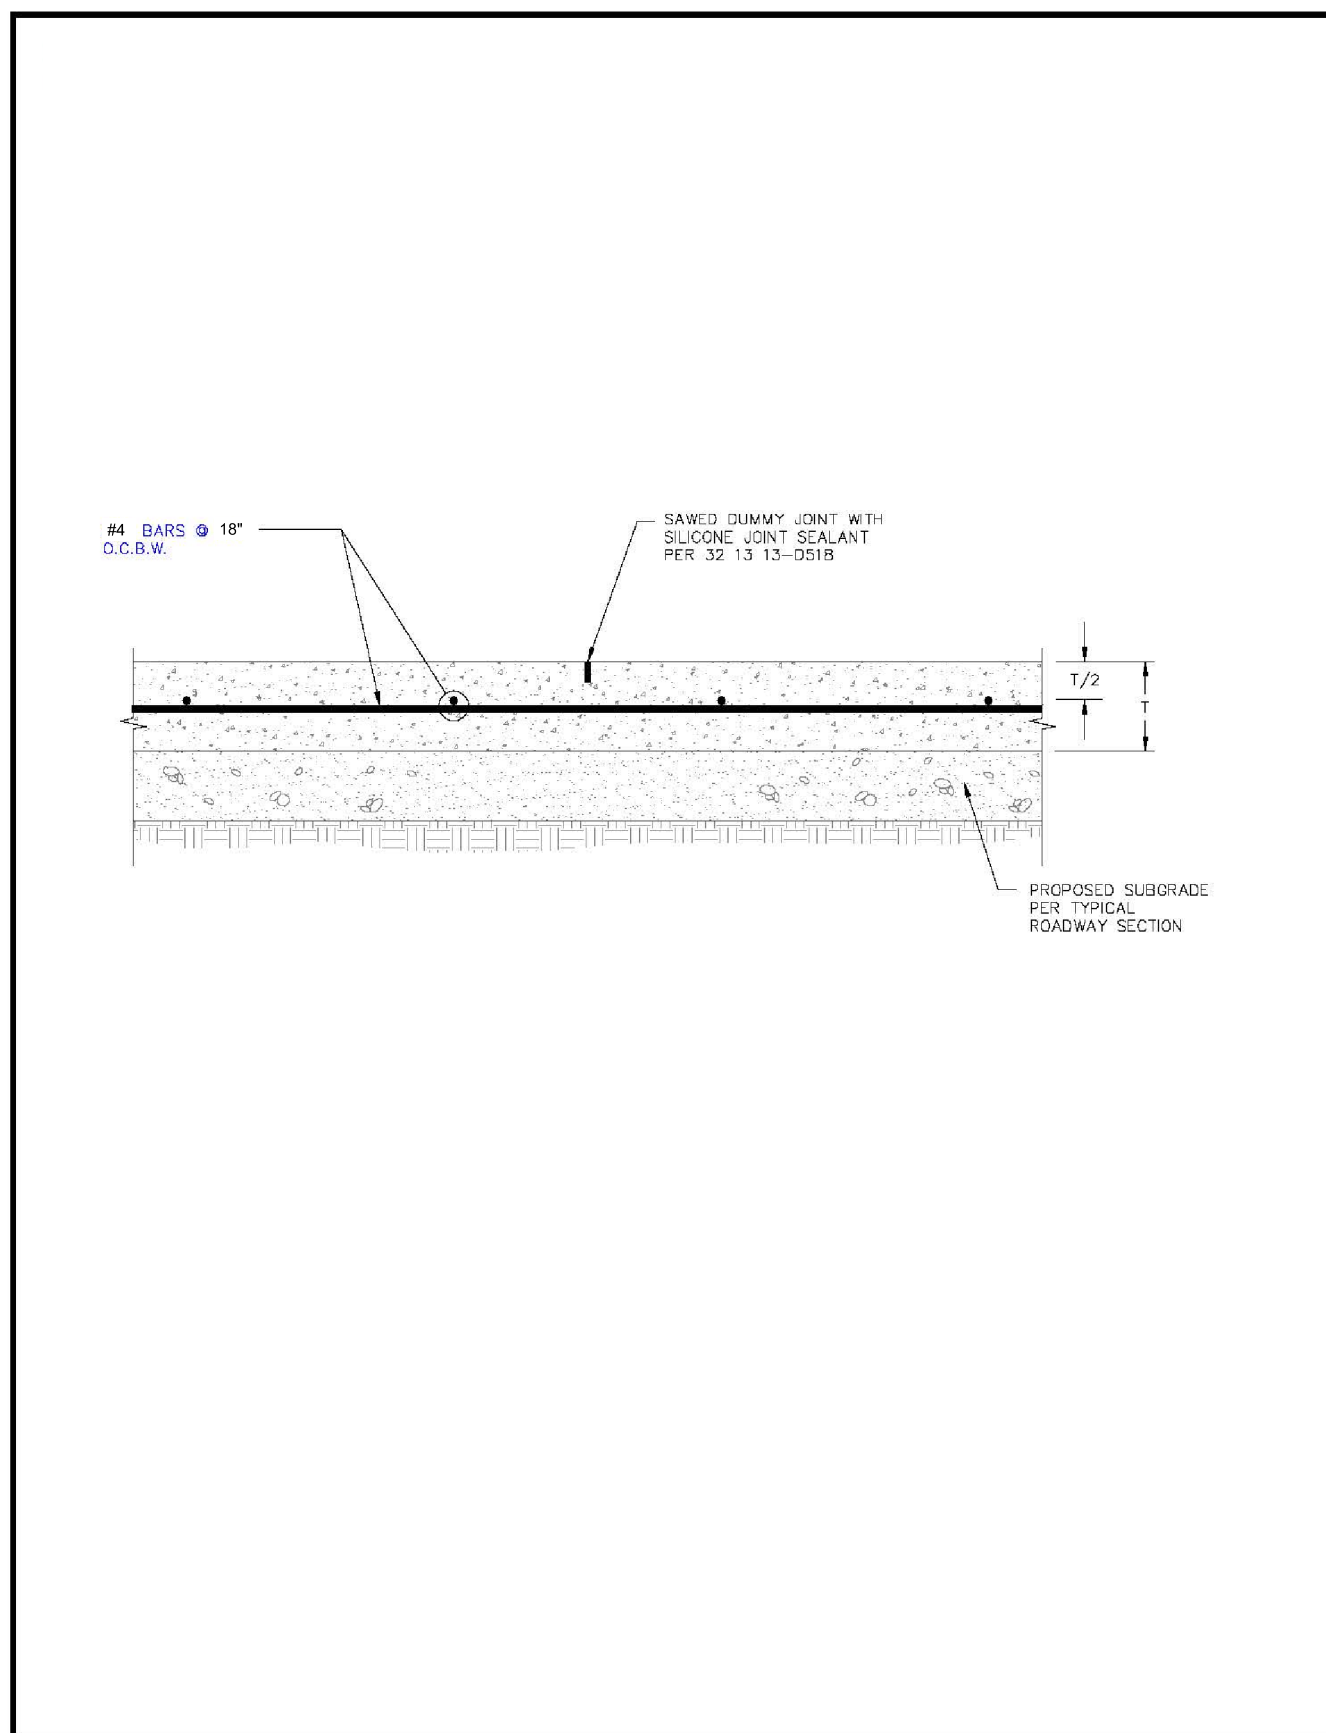


FORT WORTH CITY OF FORT WORTH, TEXAS
SAWED DUMMY JOINT REVISED: 08-31-2012
 32 13 13-D516

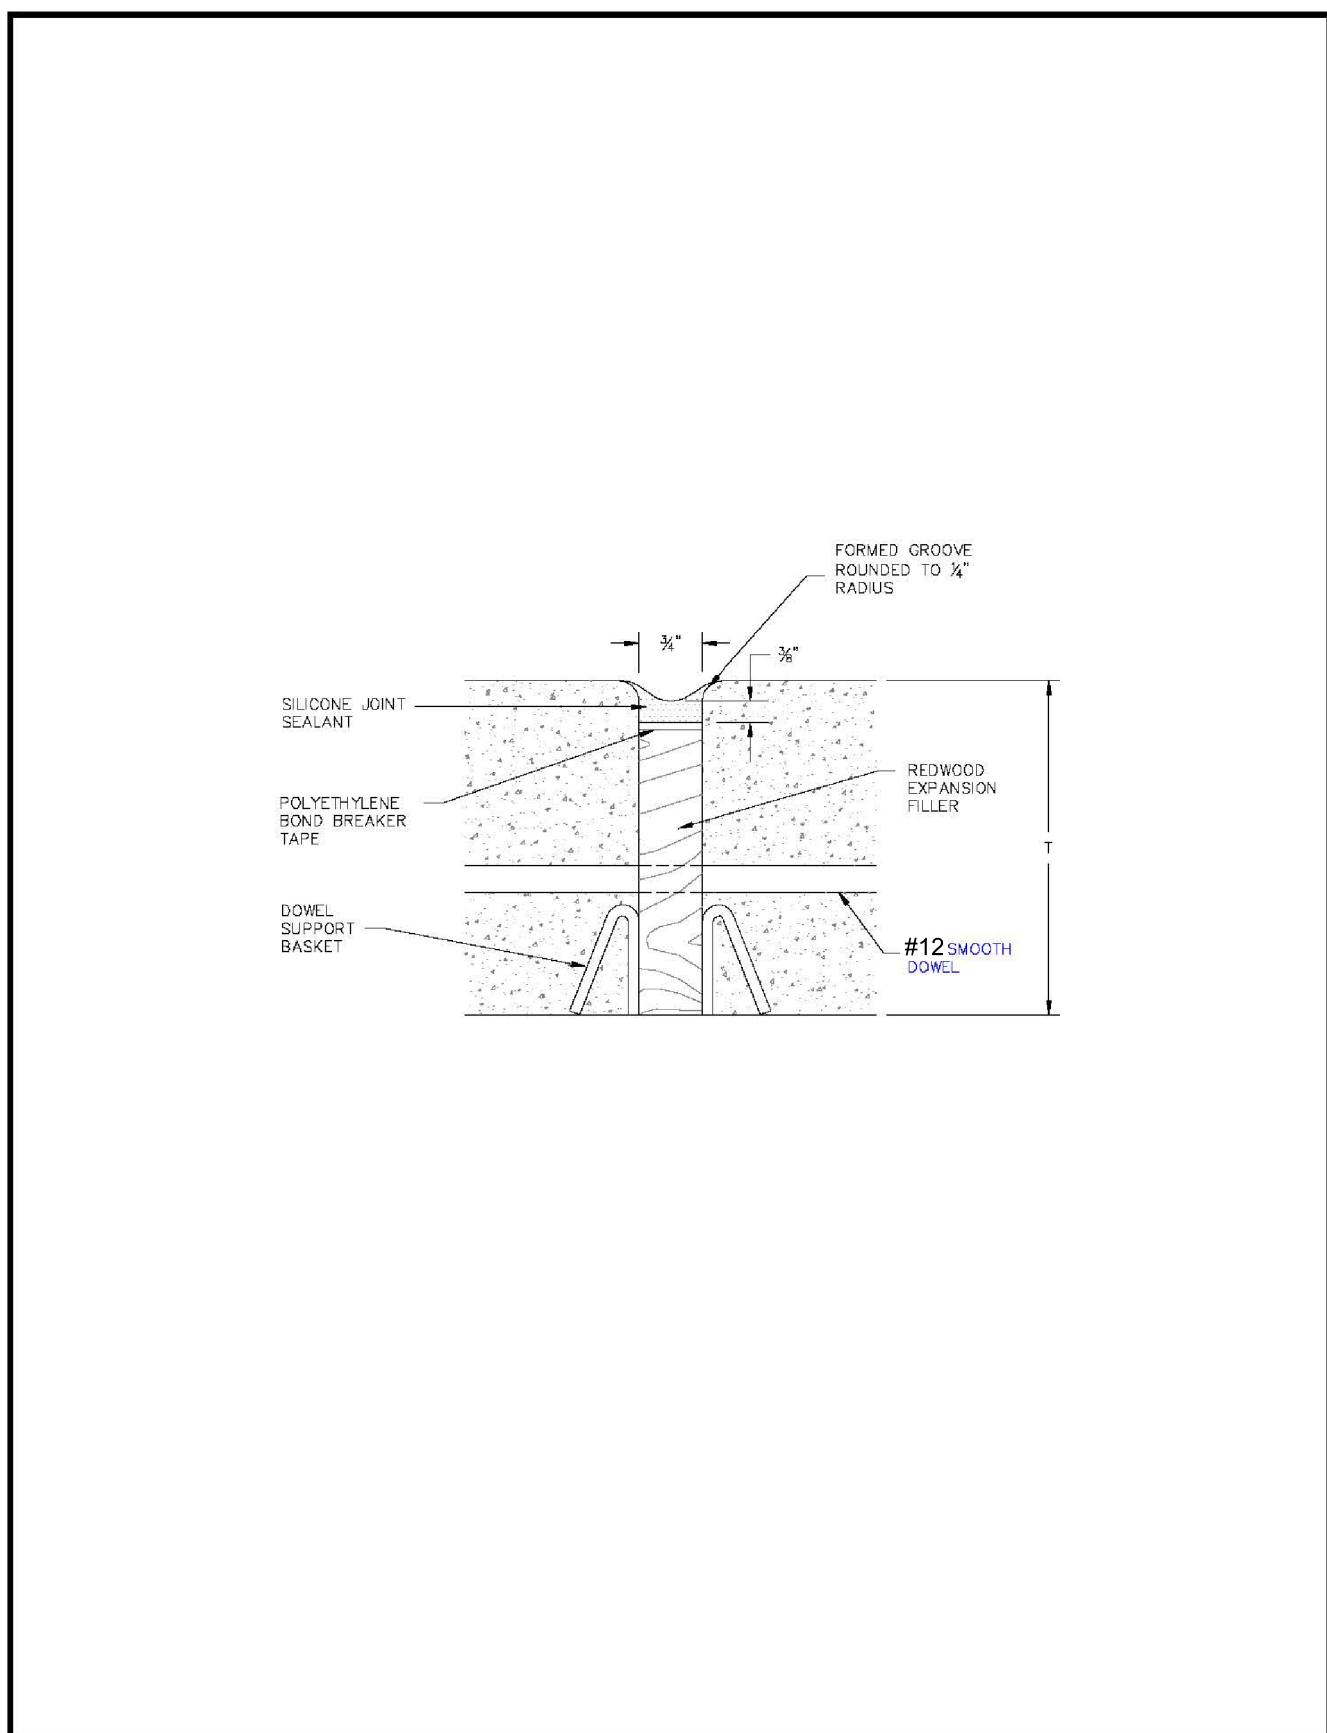


FORT WORTH CITY OF FORT WORTH, TEXAS
REDWOOD EXPANSION JOINT DETAIL REVISED: 08-31-2012
 32 13 13-D517

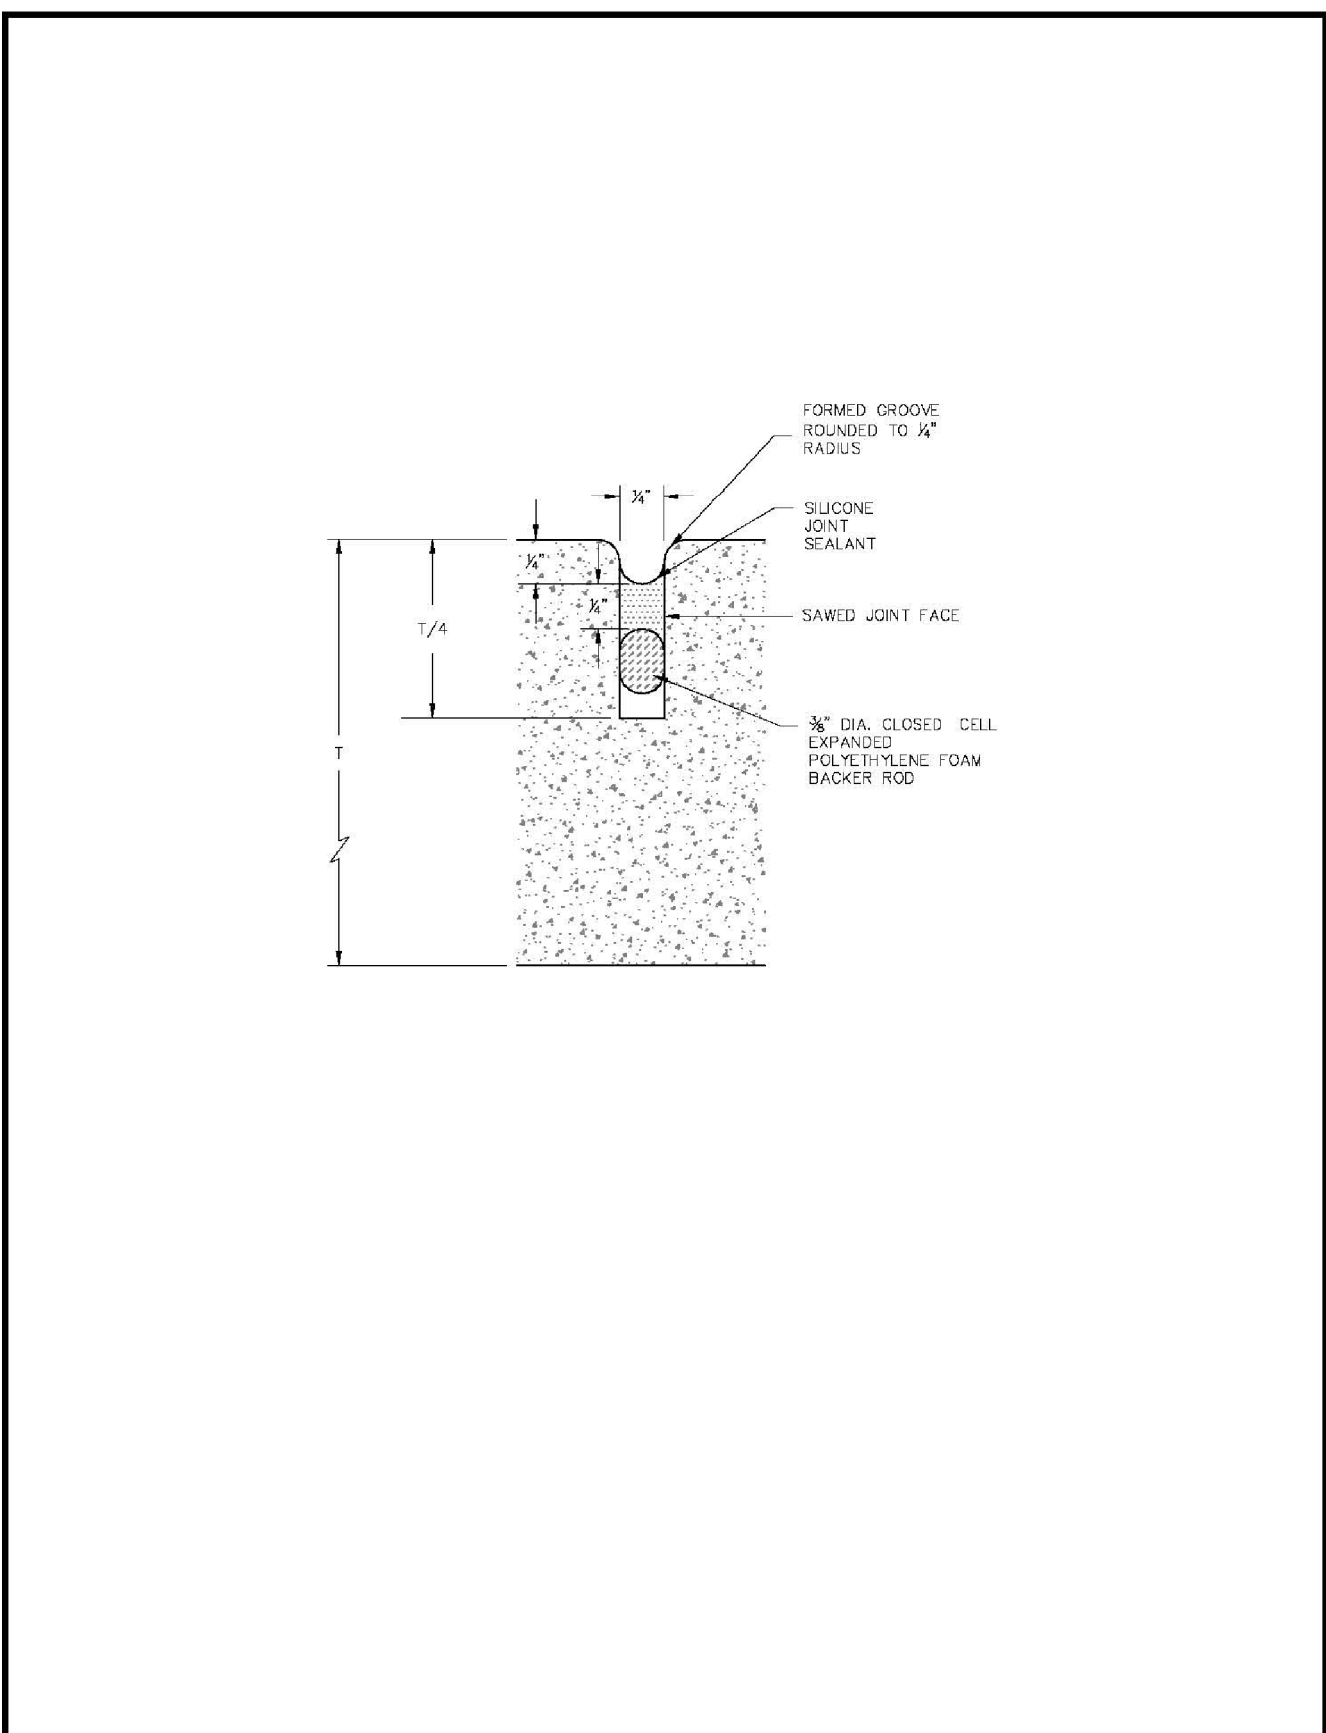


FORT WORTH CITY OF FORT WORTH, TEXAS
SAWED JOINT DETAIL REVISED: 08-31-2012
 32 13 13-D518

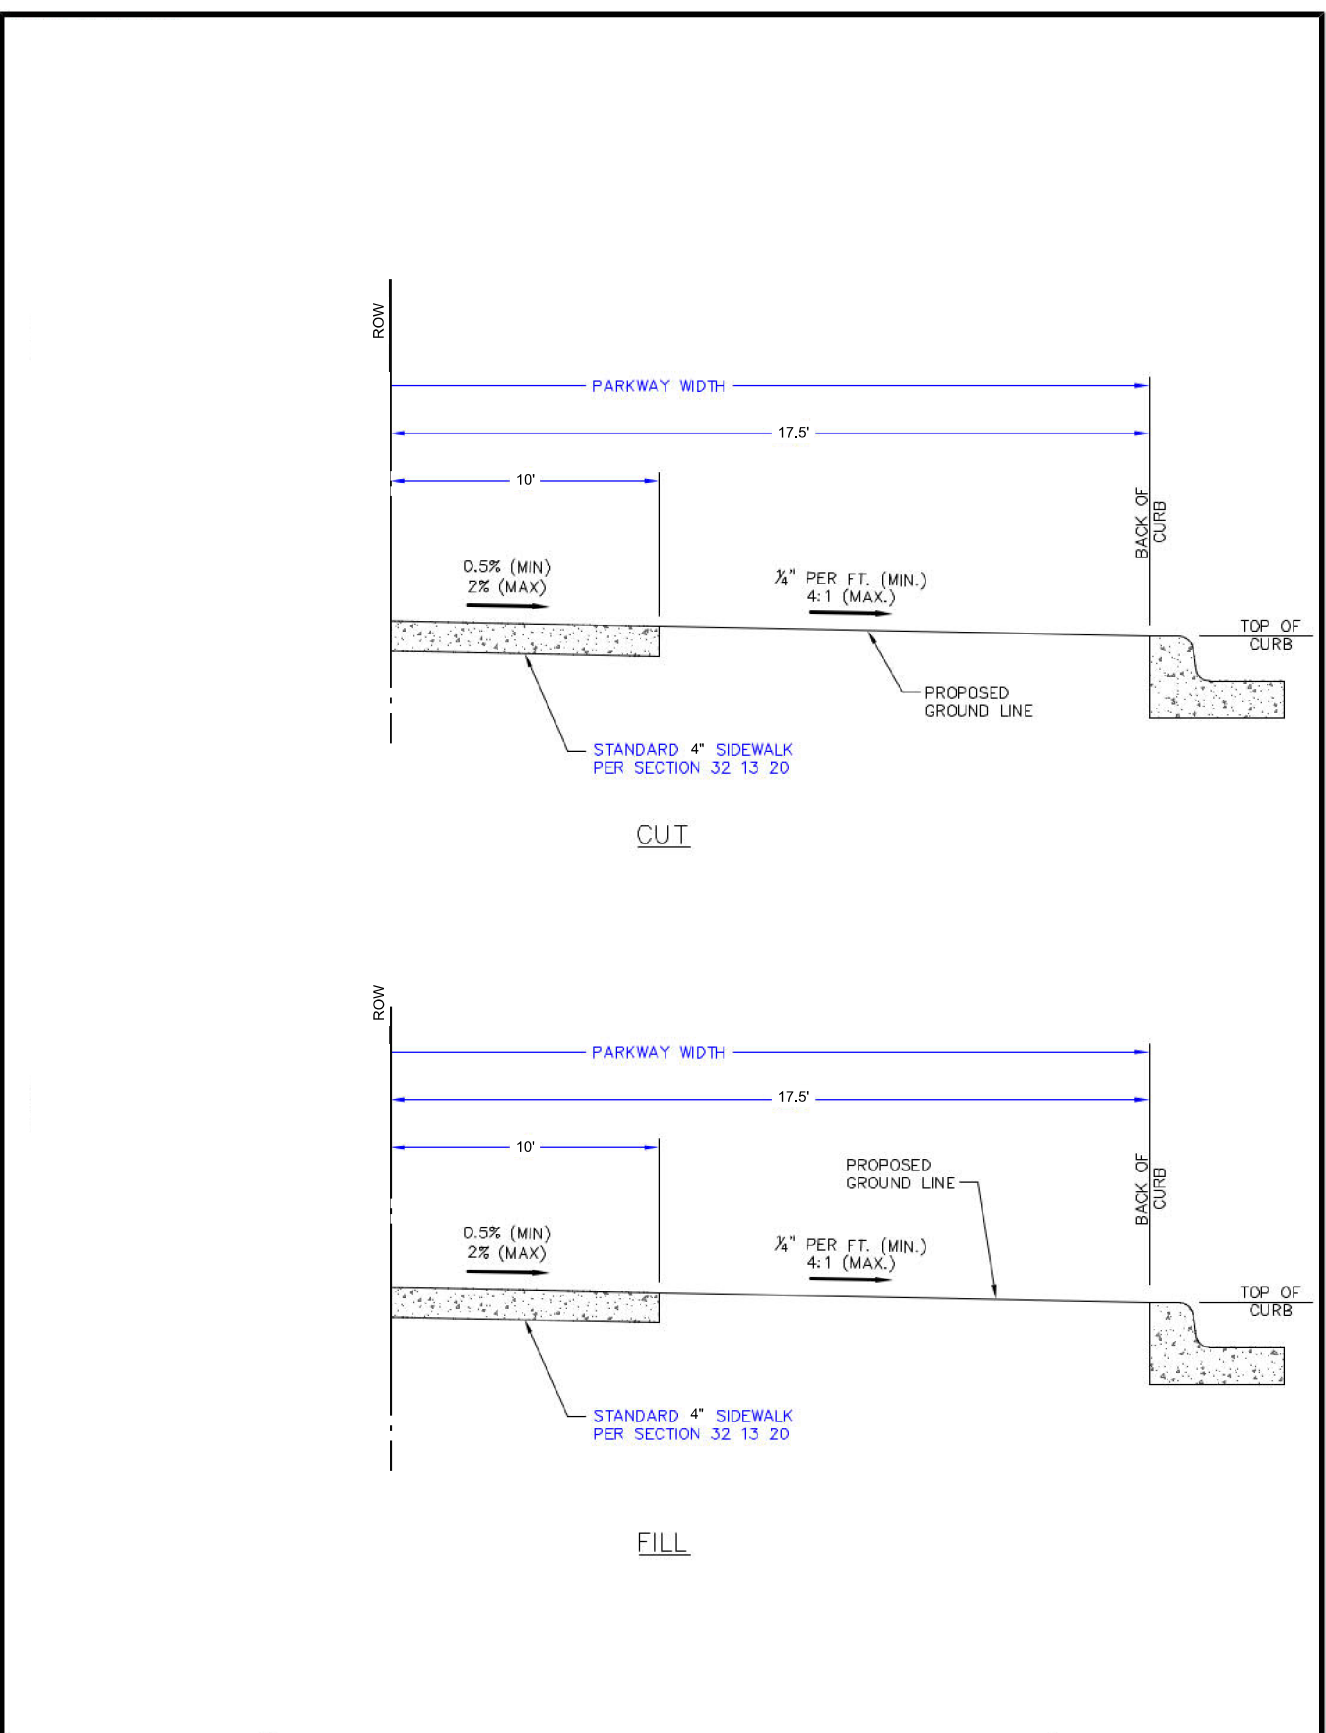

FORT WORTH CITY OF FORT WORTH, TEXAS
PAVED PARKWAY SECTIONS
TYPICAL PARKWAY SECTIONS REVISED: 07-28-2016
 32 13 20-D526

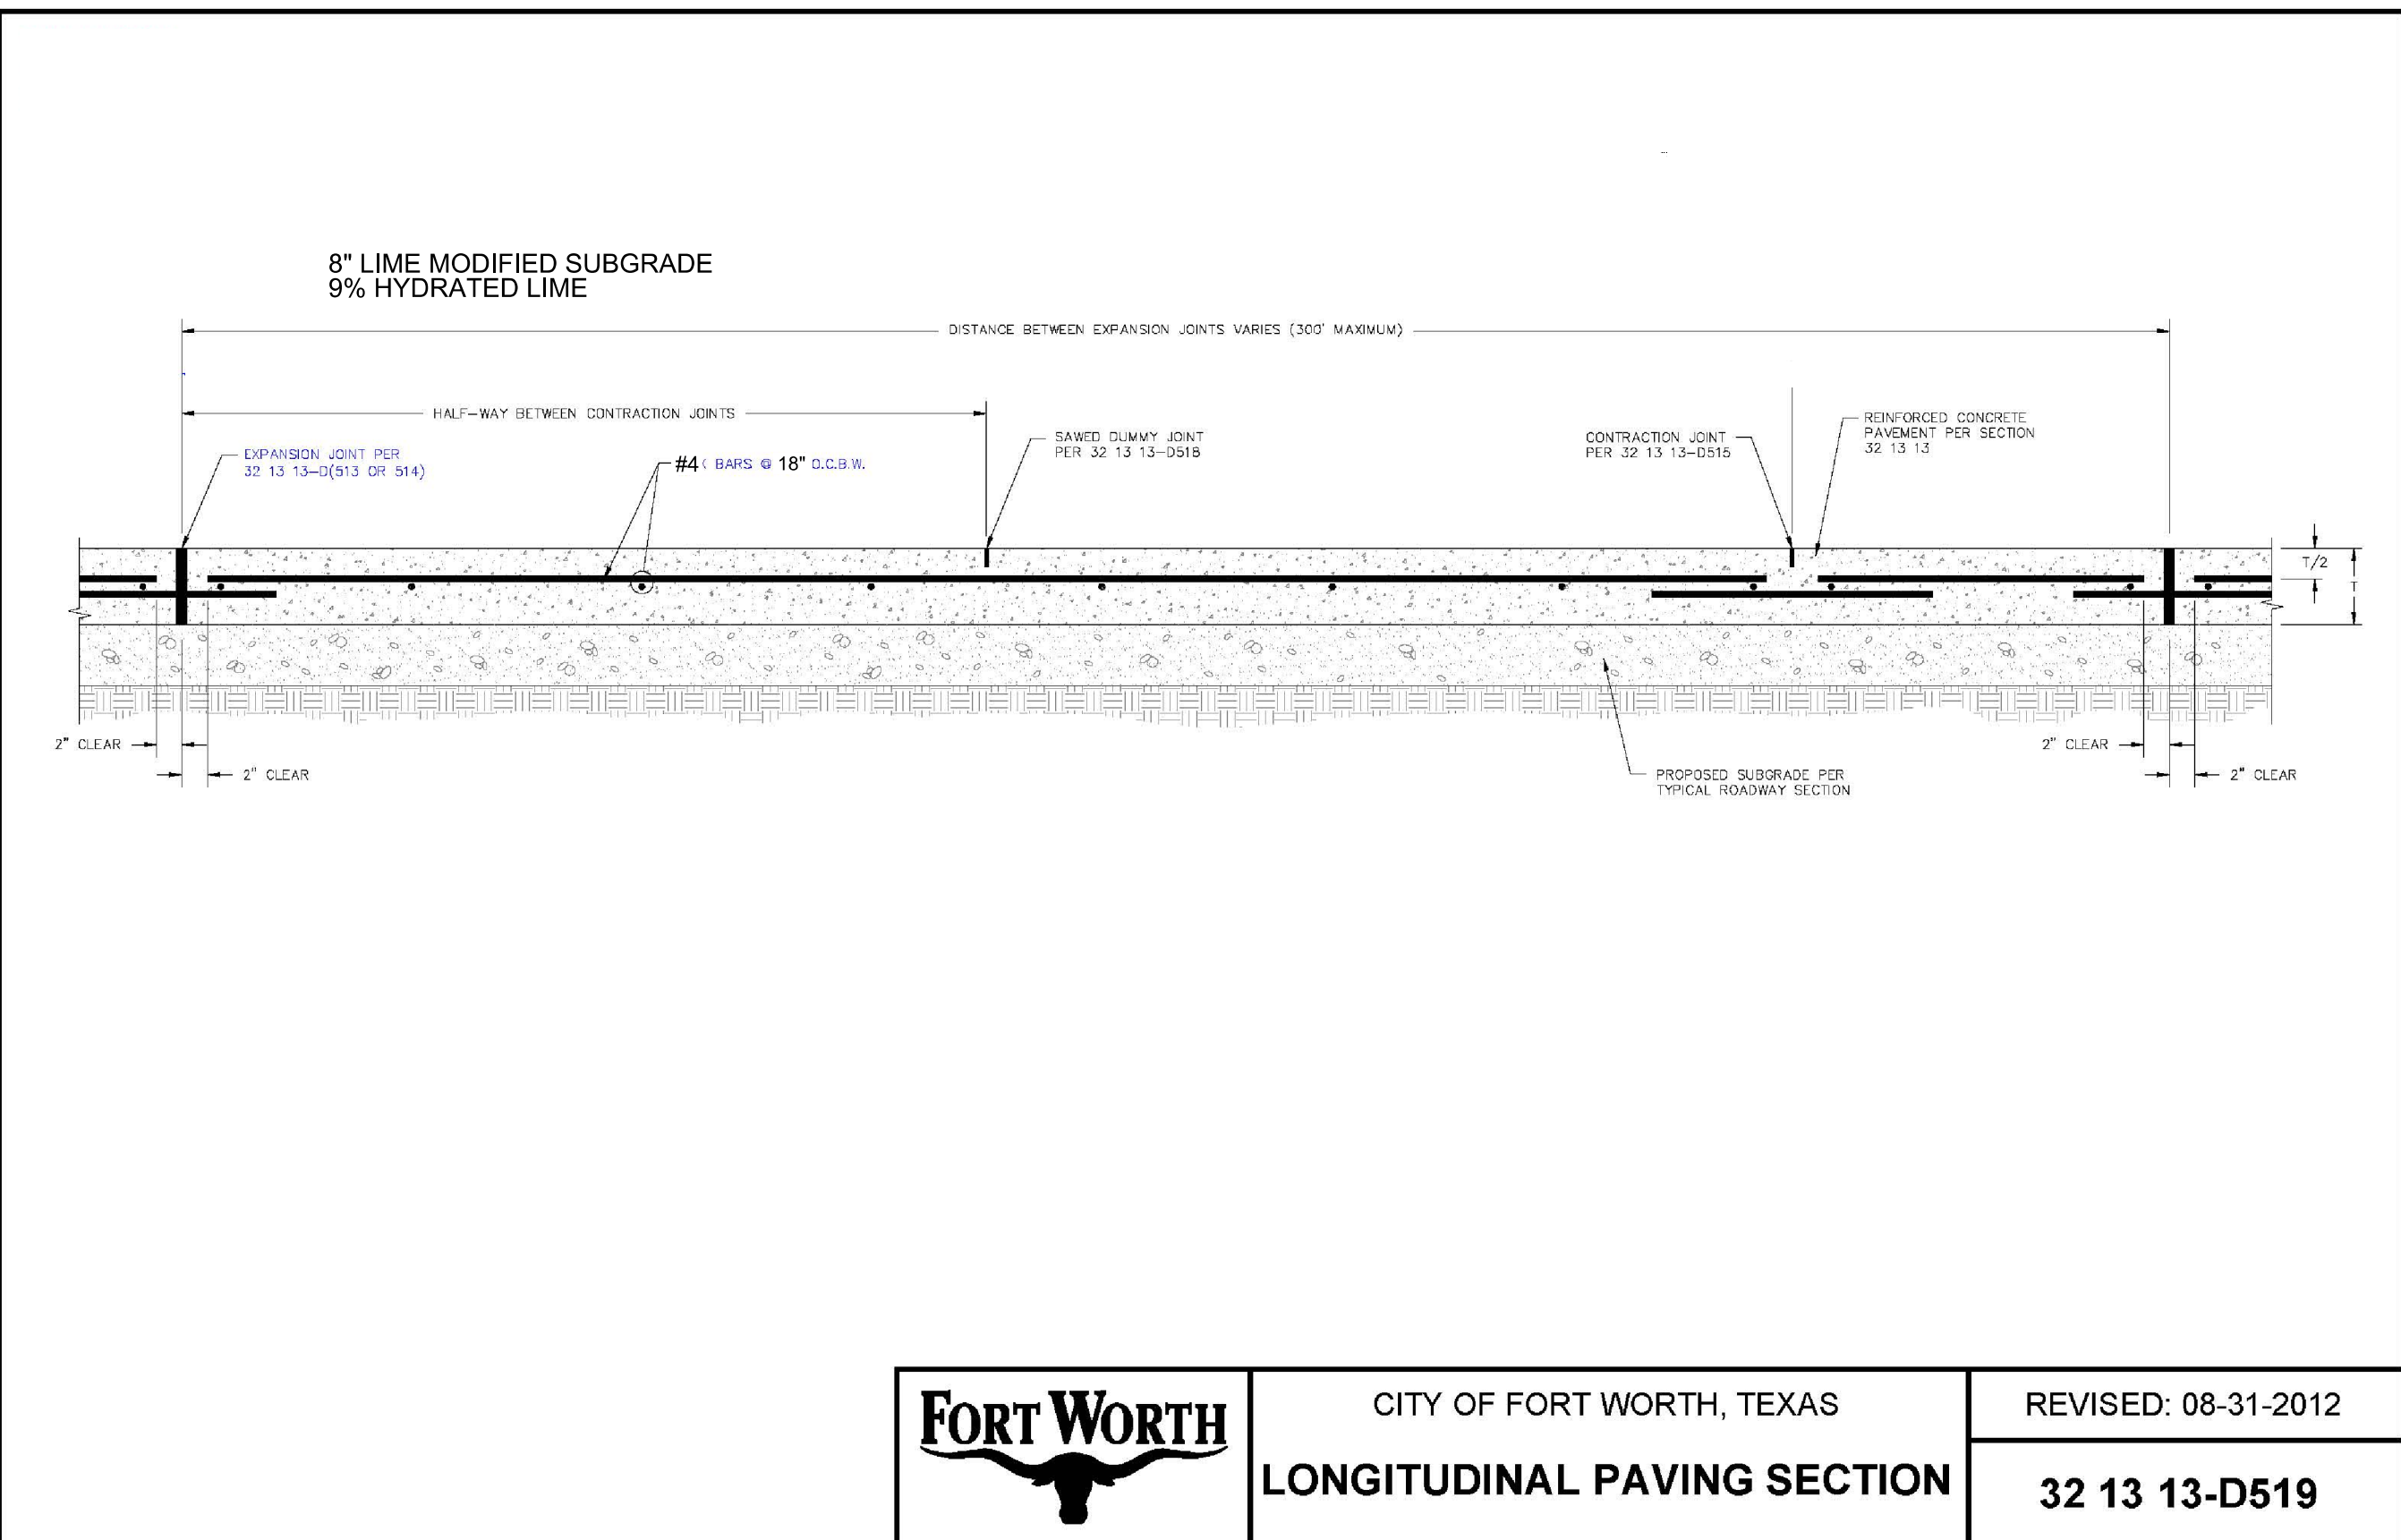

FORT WORTH CITY OF FORT WORTH, TEXAS
LONGITUDINAL PAVING SECTION REVISED: 08-31-2012
 32 13 13-D519

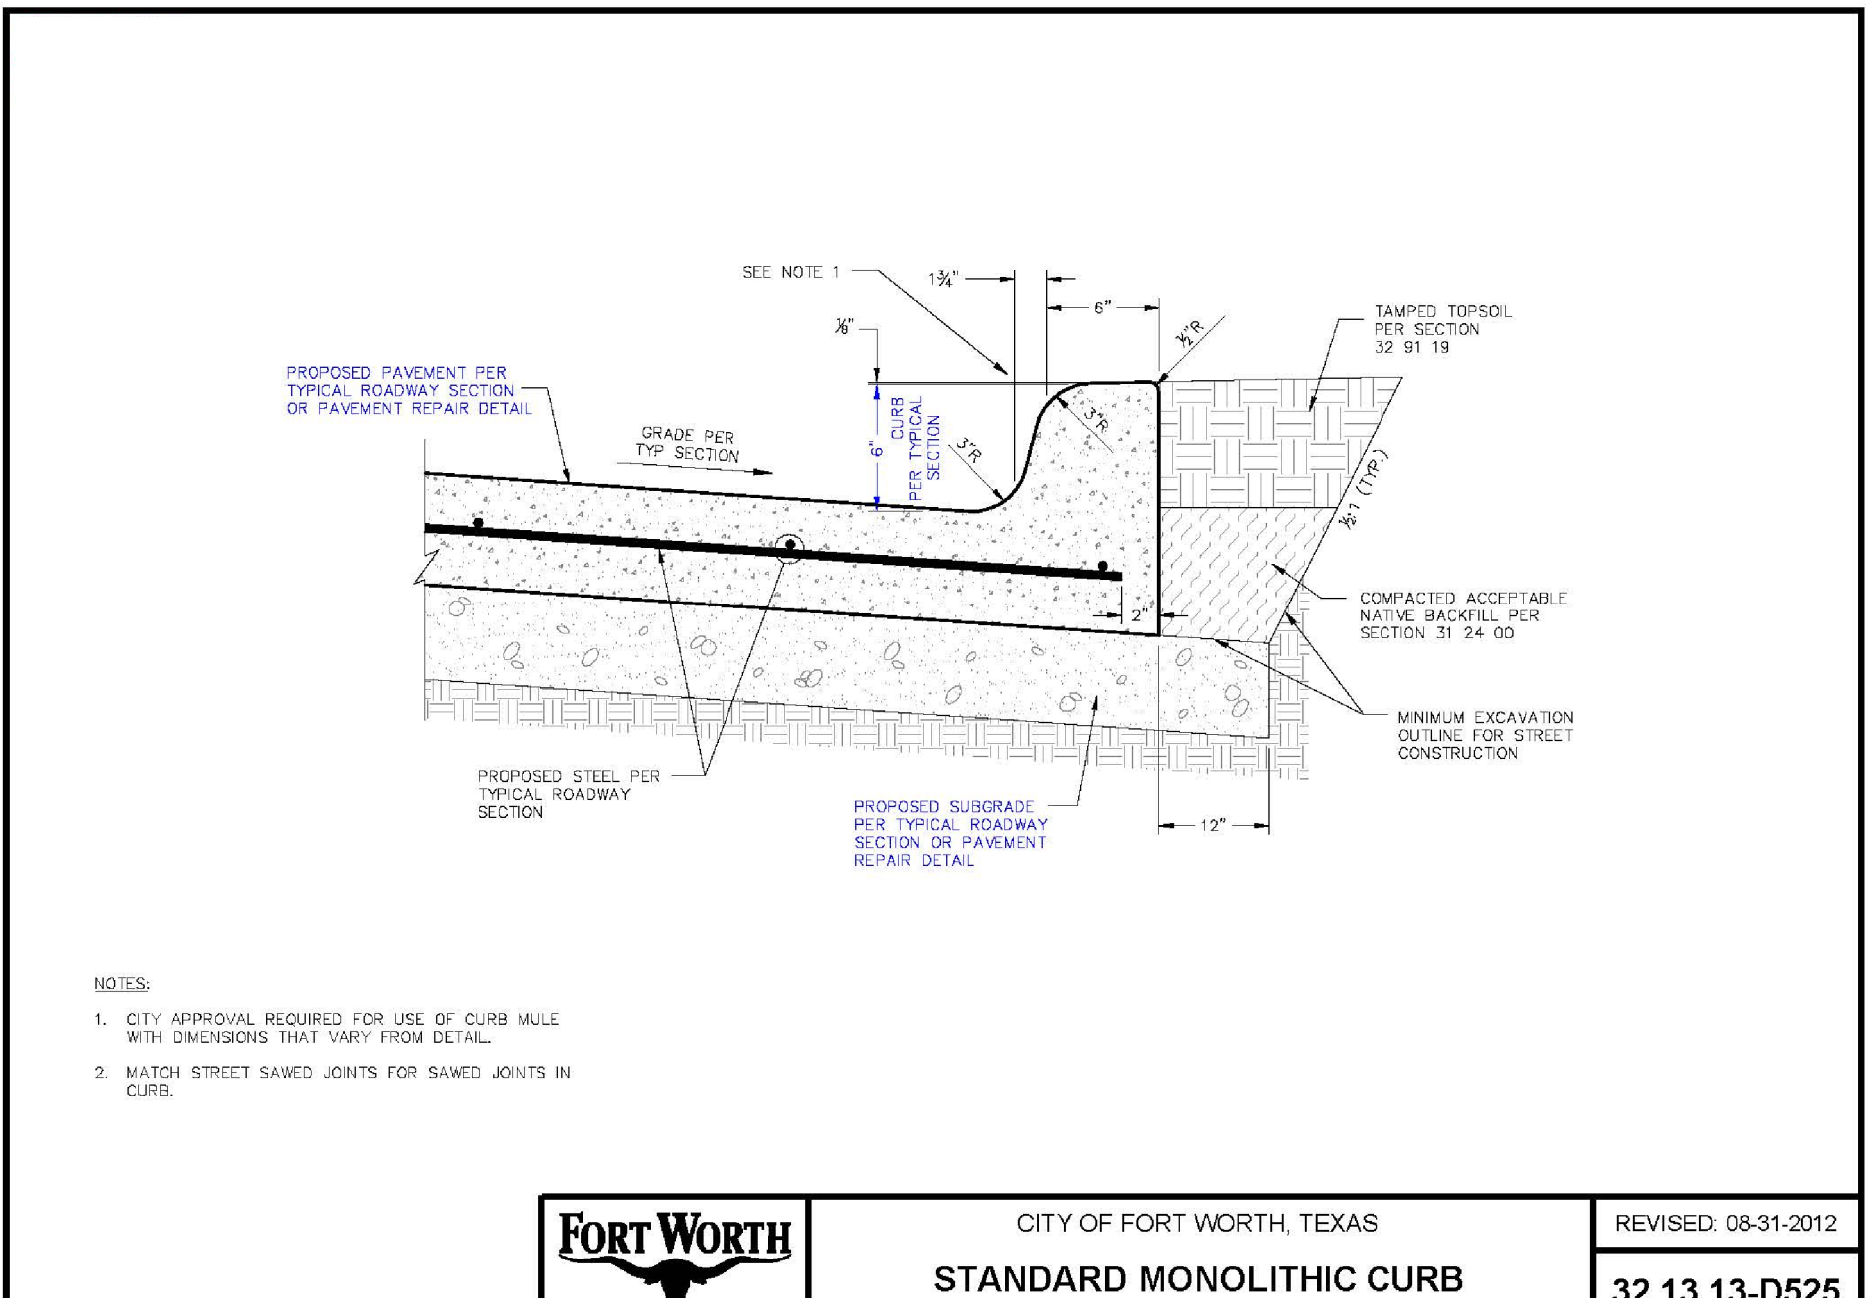

- NOTES:
- CITY APPROVAL REQUIRED FOR USE OF CURB MULE WITH DIMENSIONS THAT VARY FROM DETAIL.
 - MATCH STREET SAWED JOINTS FOR SAWED JOINTS IN CURB.

FORT WORTH CITY OF FORT WORTH, TEXAS
STANDARD MONOLITHIC CURB REVISED: 08-31-2012
 32 13 13-D525

NOTES:

THE CONCRETE SHOULD HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4,000 PSI. IT SHOULD CONTAIN A MINIMUM OF 4.5 ± 1.5 PERCENT ENTRAINED AIR.

ALL CONTRACTION JOINTS SHOULD HAVE SMOOTH DOWELS SPACE 12 INCHES ON CENTER AT MID-HEIGHT OF SLAB. PER GEOTECHNICAL REPORT # 95165202

REV.	DATE	REMARKS

INTERMODAL PARKWAY

PAVING DETAIL

CITY OF FORT WORTH, TEXAS
 TRANSPORTATION AND PUBLIC WORKS DEPT.
 ENGINEERING DIVISION

PELTON LAND SOLUTIONS

9800 HILLWOOD PARKWAY
 SUITE 250
 FORT WORTH, TX 76177
 PHONE: 817-562-3350
 TX FIRM NO 12207

DESIGNED: RZ	DATE: OCT 2022	FILE	SHEET
DRAWN: TCG			C511
CHECKED: KTW			

G:\JOB\HWA17030_01_Intermodal\MasterDev\Civil\CAD_Public_Construction_Plans\C511-HWA17030_01-C-PAV-DET13.RVT